

Appendix no. F/31304/04/26 to the Test Report

Product name: Leichte Weihrauch Gesichtscreme Boswellia sacra
Sample number: 31304/04/26
Test type: In-use / instrumental test (sensitive skin)
Test start date: 20.04.2026
Test end date: 22.05.2026
Report date: 29.05.2026

Test purpose

Aims of the in-use test:

- assessment of long-term sensitive skin tolerance to the tested product;
- assessment and verification of the performance (properties) of the product declared by the Manufacturer;
- Consumer evaluation.

The aim of the instrumental test:

- assessment and verification of the performance (properties) of the product declared by the Manufacturer – the long-term effect.

Microbiological purity test

The product is microbiologically approved.

Microbiological purity tests were ~~carried out in the GBA POLSKA Laboratory~~ / delivered by the Customer *.

* delete as appropriate

Dermatological test

The product is dermatologically approved.

Dermatological tests were ~~carried out in the GBA POLSKA Laboratory~~ / delivered by the Customer *.

* delete as appropriate

Product characteristics

PARAMETER	DESCRIPTION
Appearance	Emulsion
Colour	White/beige
Smell	Characteristic of the raw materials used
Packaging	Commercial
Purpose	Skin care
Directions for use	Apply 2–3 times daily to the face and décolleté and massage in thoroughly. Not for use on children under 3 years. For external use only.
Application period	4 weeks

Qualitative composition of the product

INCI ():** AQUA, BOSWELLIA SACRA RESIN WATER, HELIANTHUS ANNUUS SEED OIL*, SIMMONDSIA CHINENSIS SEED OIL*, BOSWELLIA SACRA RESIN POWDER, GLYCERYL STEARATE CITRATE, PENTYLENE GLYCOL, BUTYROSPERMUM PARKII BUTTER*, CALOPHYLLUM INOPHYLLUM SEED OIL*, RUBUS IDAEUS SEED OIL*, ARGANIA SPINOSA KERNEL OIL*, CETYL ALCOHOL, SODIUM HYALURONATE, TOCOPHEROL, BOSWELLIA SACRA RESIN OIL, CAESALPINIA SPINOSA GUM. °PINENE °LIMONENE. *from controlled organic cultivation °components of essential oils

(**) – The Customer is fully responsible for the compliance of the samples delivered for testing with the declared qualitative composition; the Laboratory does not analyze the composition of the sample for compliance with the current legal requirements.

The scope of the tests is in accordance with:

- Regulation of the European Parliament and Council Regulation (EC) No 1223/2009 of 30 November 2009 on cosmetics
- Regulation of the European Parliament and Council Regulation (EC) No 655/2013 of 10 July 2013 on cosmetics
- Cosmetics Europe - The Personal Care Association Guidelines „Product test Guidelines for the Assessment of Human Skin Compatibility 1997”
- Cosmetics Europe - The Personal Care Association „Guidelines for the Evaluation of the Efficacy of Cosmetic Products 2008”

Research methodology

In-use test was carried out:

- according to the internal procedure of the Cosmetics Research Centre, PB-34/LK;
- under the guidance of a specialist and a dermatologist;
- on a group of 20 study subjects with sensitive skin at home.

The tested sample was used in accordance with the Manufacturer's recommendations. After the declared time of application, the subjects were asked to fill in the evaluation questionnaire according to their own feelings. In the evaluation sheet, in the part containing the Manufacturer's declarations, a 4-point scale was used, with an equal number of positive and negative answers.

A declaration may be confirmed when the sum of positive answers exceeds 50% of the assessments of all subjects.

The test results may be influenced by factors such as: the type and condition of the skin, lifestyle, genetic conditions, individual preferences, environmental conditions.

Instrumental tests were carried out:

- in the Cosmetics Research Centre of GBA POLSKA;
- under the guidance of a specialist;
- on a group of 20 study subjects
- using specialized measuring equipment i.e. :
 - Cutometer® dual MPA580 – measurement of skin elasticity according to internal procedure PB-41LK;
 - Corneometer® CM825 – measurement of skin hydration according to internal procedure PB-40/LK;
 - Antera 3D® – skin tone analysis according to internal procedure;
 - Primos CR 300® - wrinkle analysis according to internal procedure;
- in standardized environmental conditions, i.e. in an air-conditioned room with a temperature of 20-25°C and a relative humidity of 40-60%;
- on individually selected areas of the skin, the same at the beginning of the tests (T_0) and at their end (T_1);
- on the thoroughly cleansed skin, without cosmetics.

The claim can be confirmed when there is an improvement confirmed in case of the majority of the study subjects, i.e. 11 out of 20.

Performance/properties of the product declared by the Manufacturer

The performance/properties of the product declared by the Manufacturer are included in the questions on the evaluation card.

Selection of the Study Subjects

The selection of the Study Subjects was conducted in accordance with the Research Procedure PB-34/LK, taking into account:

- The Declaration of Helsinki of 1964 (with subsequent amendments)
- Current Polish and European legal regulations
- Cosmetics Europe directives - The Personal Care Association with use of inclusion and exclusion criteria

20 subjects with sensitive skin were selected for the test. They completed a detailed questionnaire regarding their lifestyle, current health condition, past illnesses, eating habits, use of medicines and stimulants.

All subjects selected for the study met the requirements for inclusion in the study and signed consent to consciously participate in it. They were also informed about the purpose of the study, method of testing and about possible side effects.

All participants of the long-term effect study were obliged to:

- use the product regularly during the period of 4 weeks,
- not to use any other products with identical or analogous properties during the tests,
- not to change, for the entire duration of the test, the skin care products used so far, intended for purposes other than the tested product,
- immediately discontinue the use of the product and to report to the specialist supervising the research in case any undesirable effects occurred.

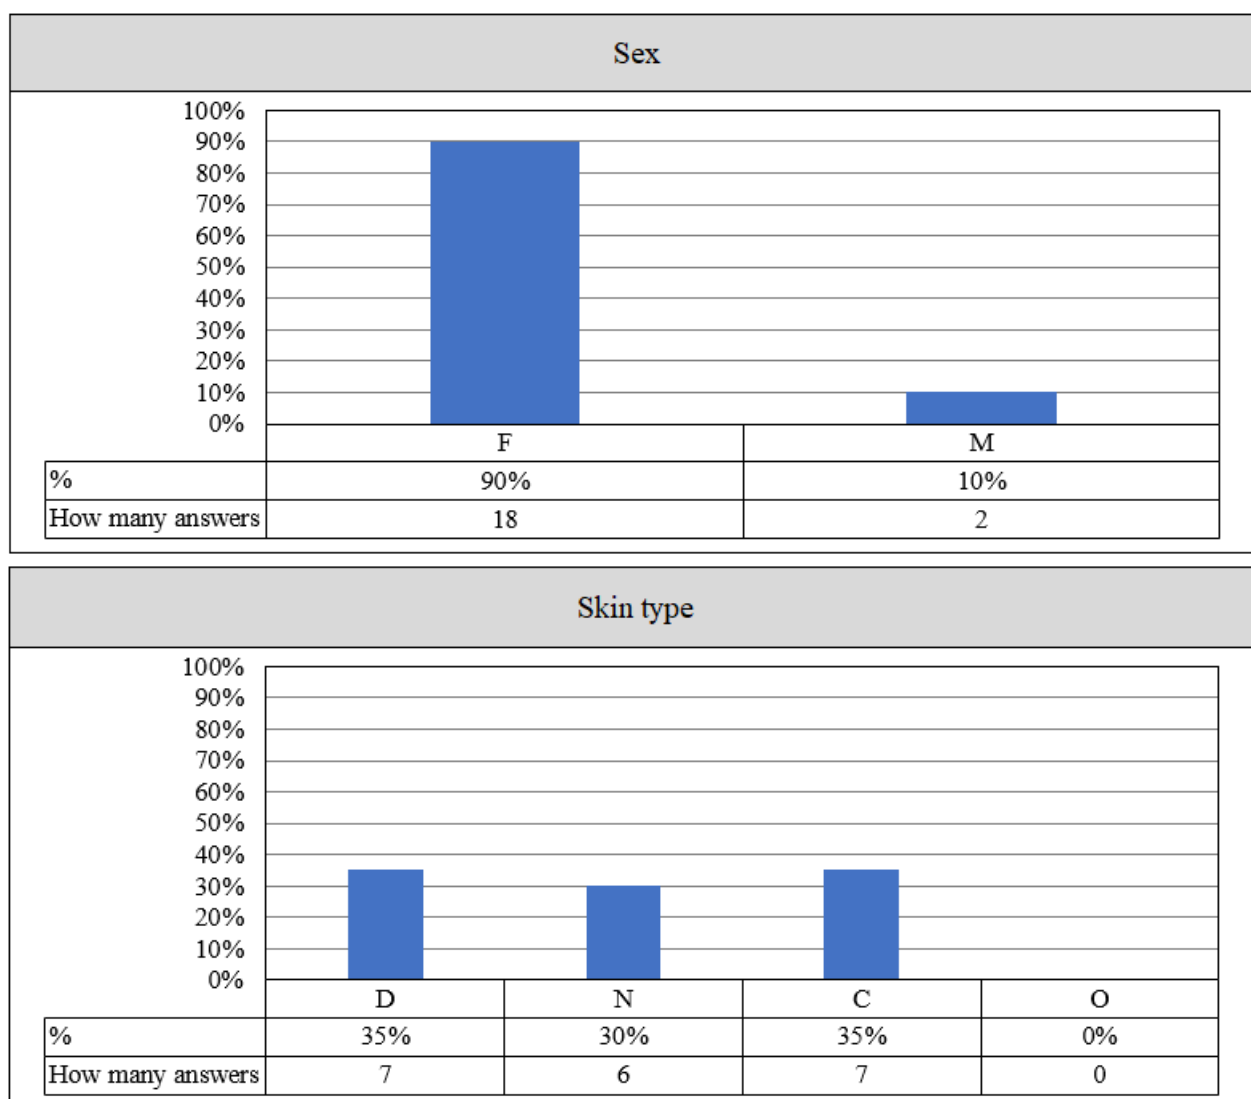
Characteristics and composition of the group participating in the study

The study was conducted on a group of 20 subjects selected according to the directions.

Subject's code	Age	Sex	Skin type	Is the skin sensitive?	Feelings / side effects
1	47	F	N	YES	(-)
2	59	F	N	YES	(-)
3	54	F	D	YES	(-)
4	46	F	C	YES	(-)
5	56	F	D	YES	(-)
6	47	F	C	YES	(-)
7	40	F	N	YES	(-)
8	59	F	C	YES	(-)
9	59	F	D	YES	(-)
10	59	F	N	YES	(-)
11	55	F	C	YES	(-)
12	49	F	D	YES	(-)
13	46	F	D	YES	(-)
14	52	F	C	YES	(-)
15	52	F	N	YES	(-)
16	54	M	N	YES	(-)
17	50	M	C	YES	(-)
18	50	F	C	YES	(-)
19	52	F	D	YES	(-)
20	52	F	D	YES	(-)




Legend: F – female, M – male, N – normal, D – dry, C – combination, (-) – none




Statistics of people participating in the in-use test




In-use test results

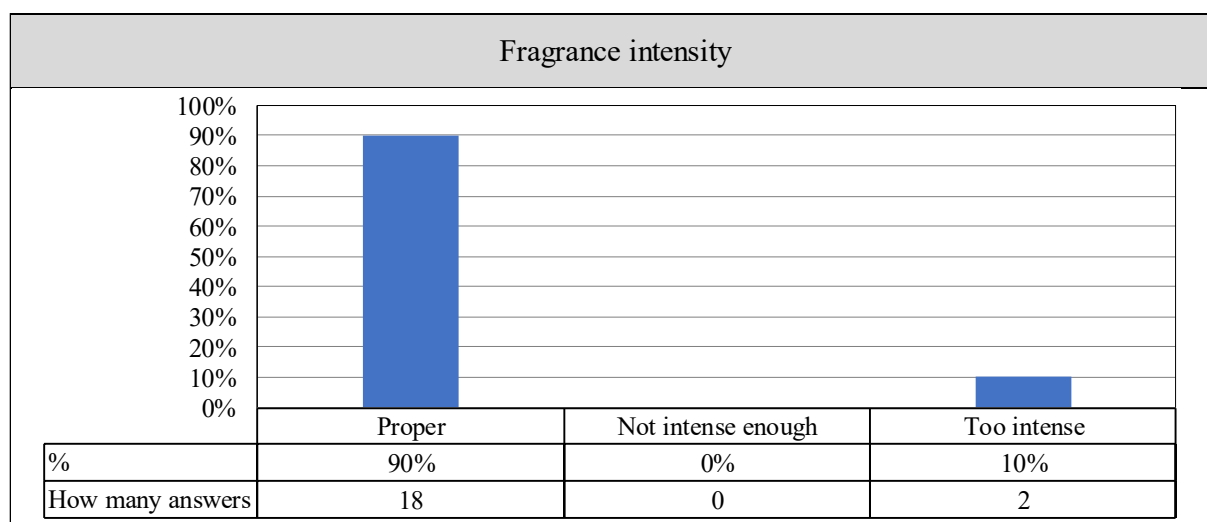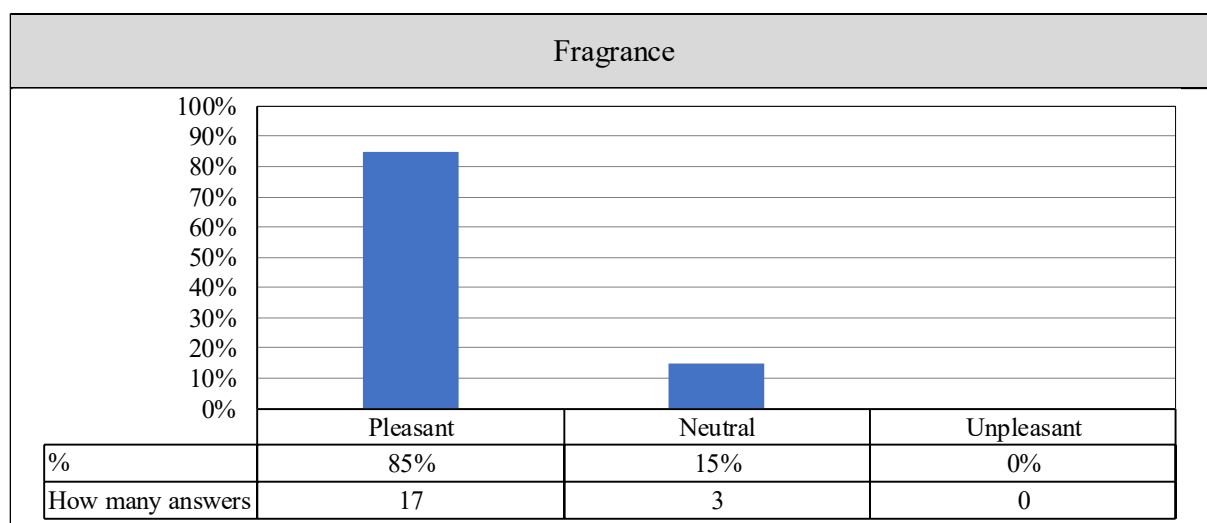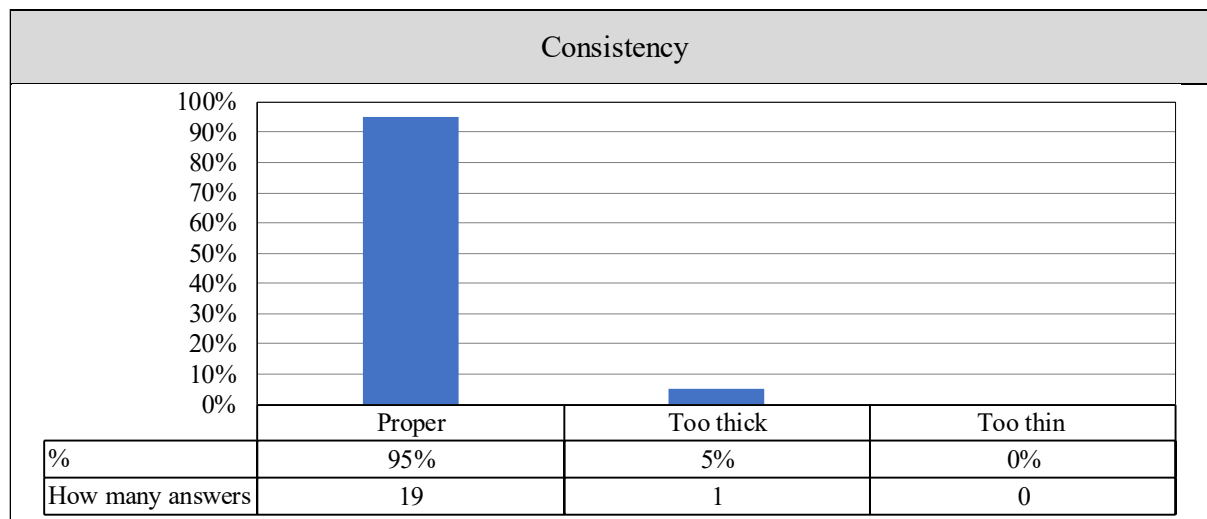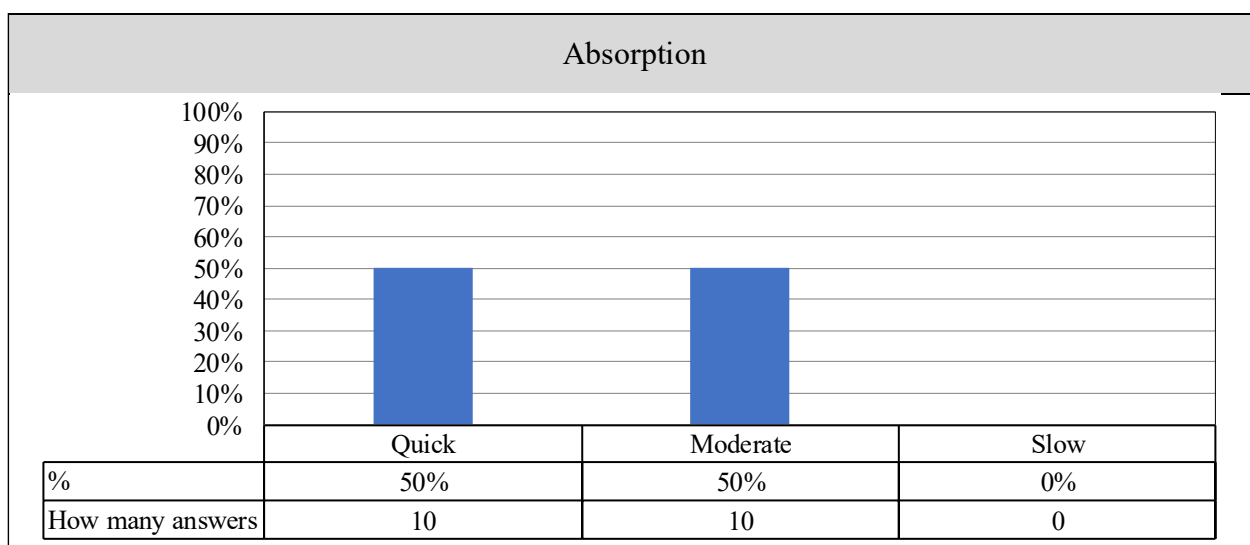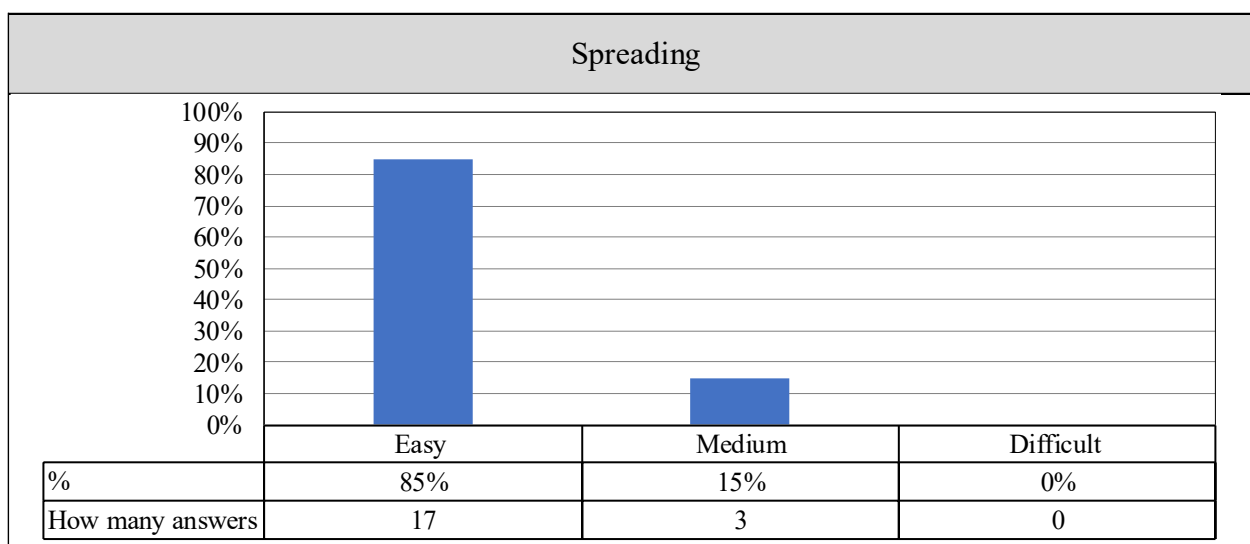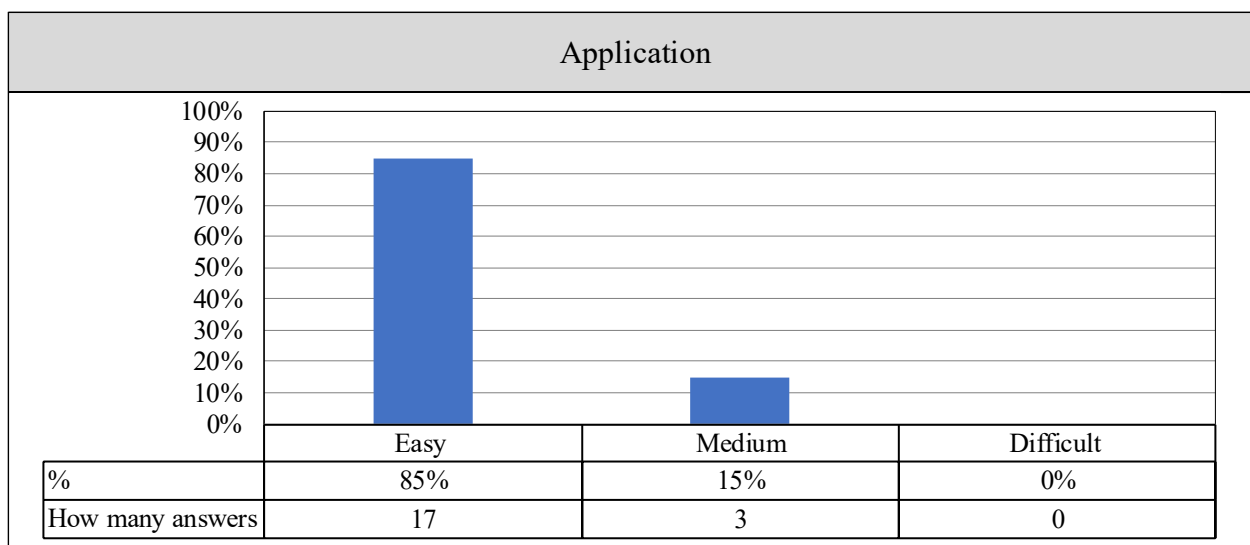
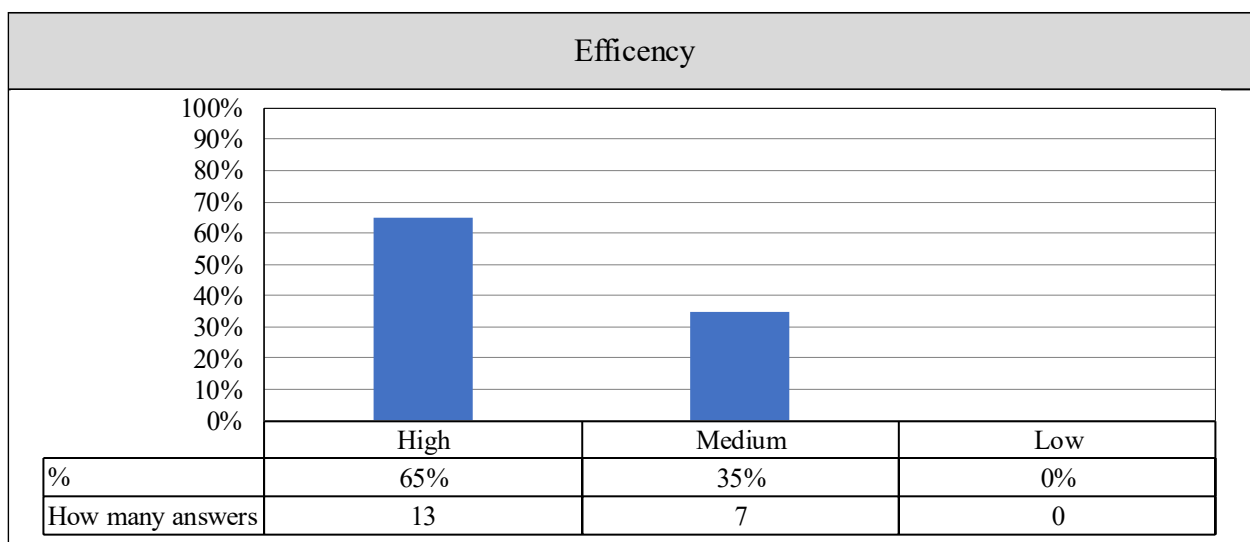
1. Results of organoleptic evaluation












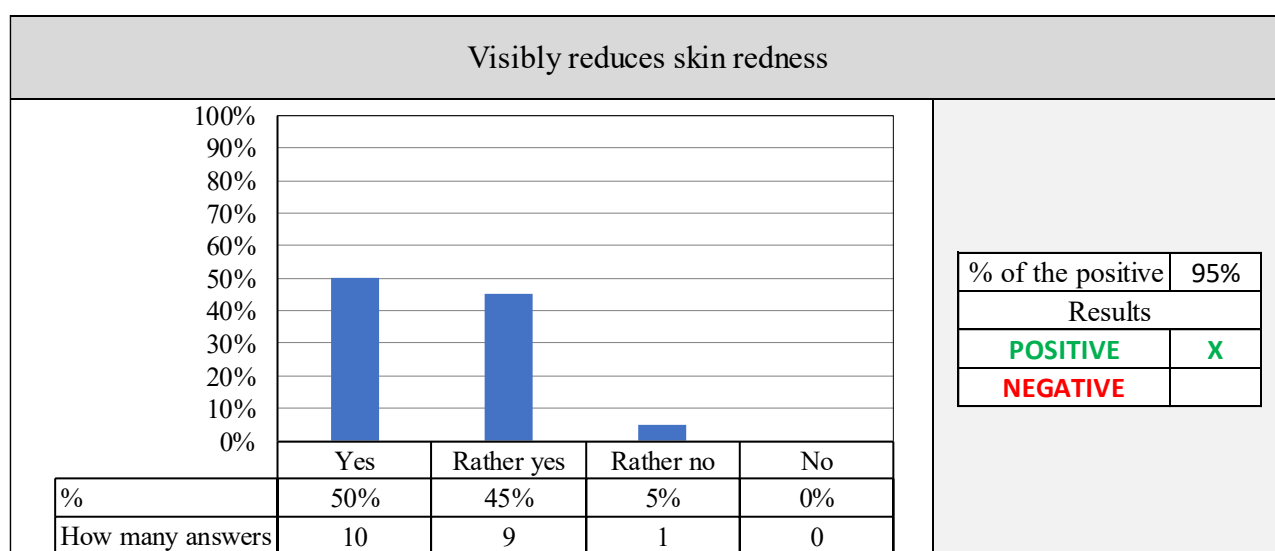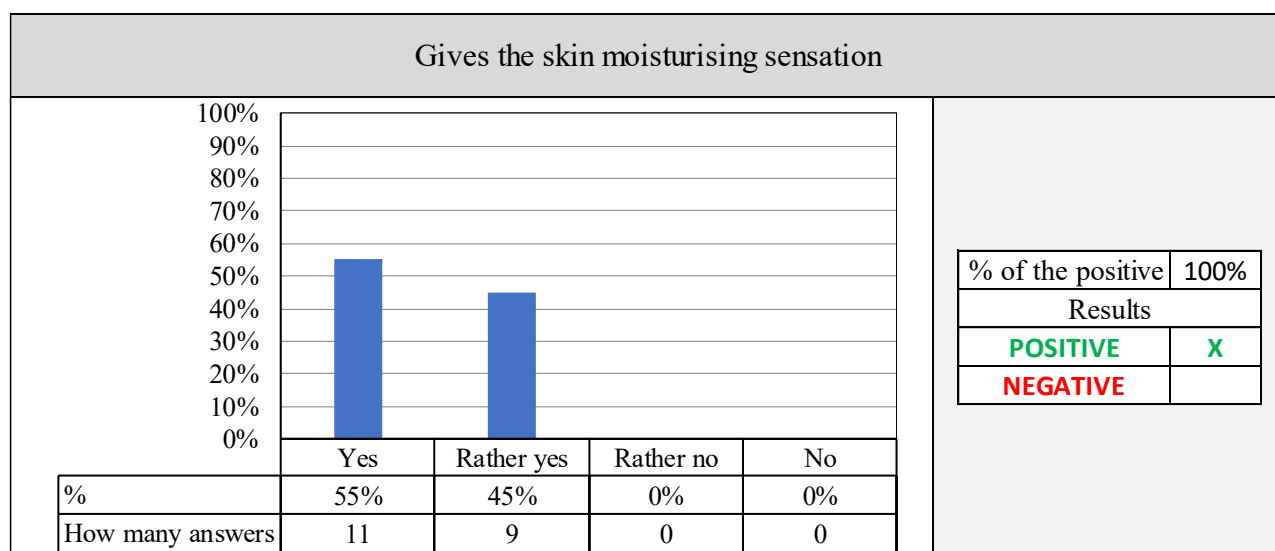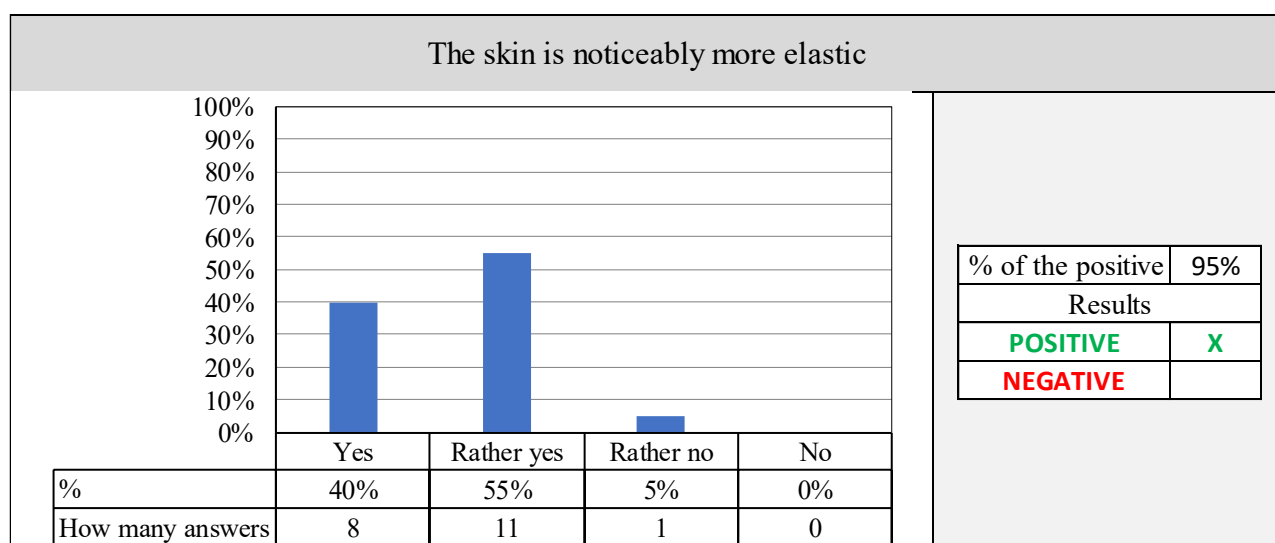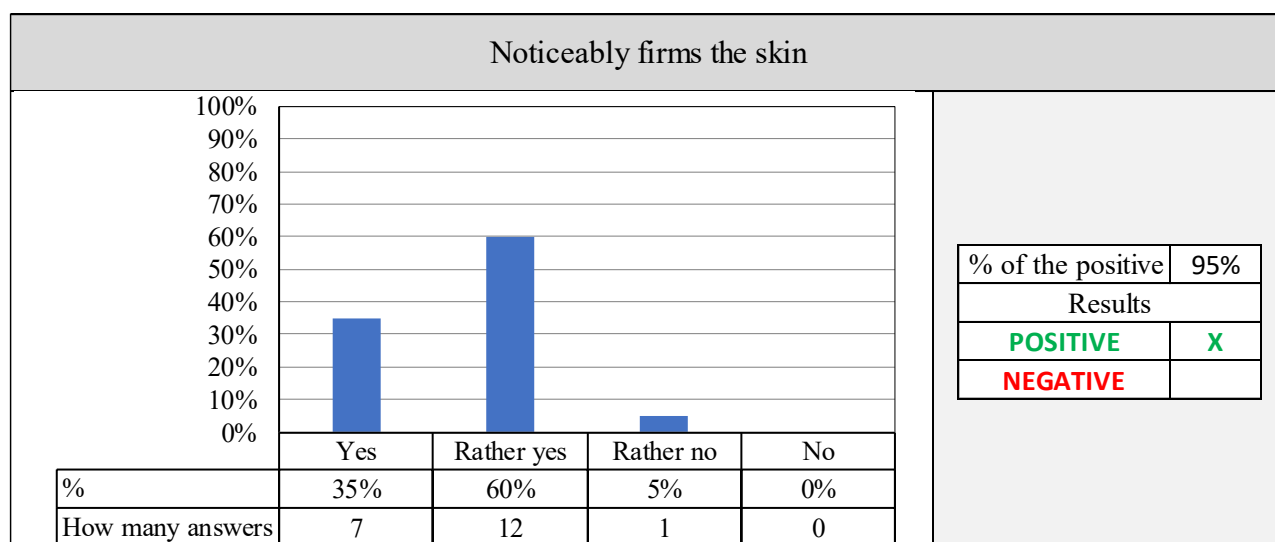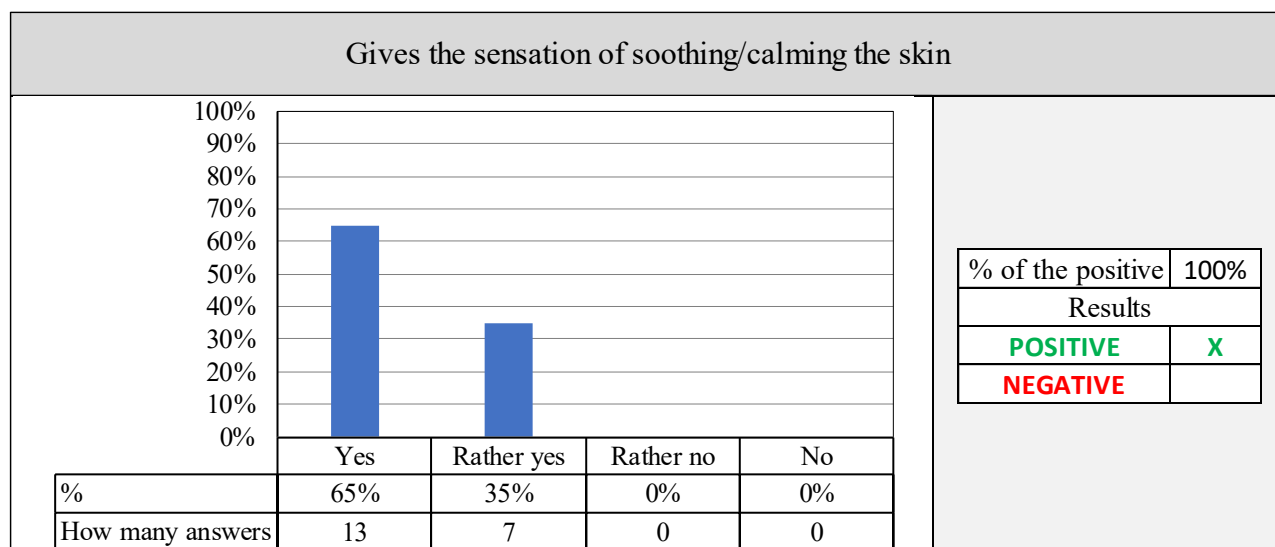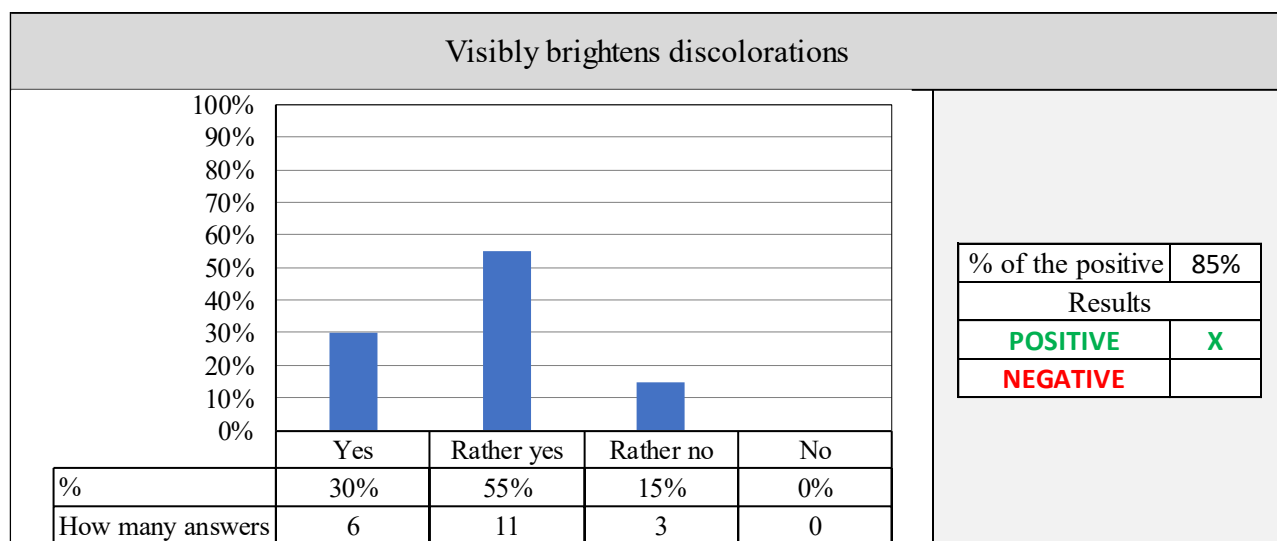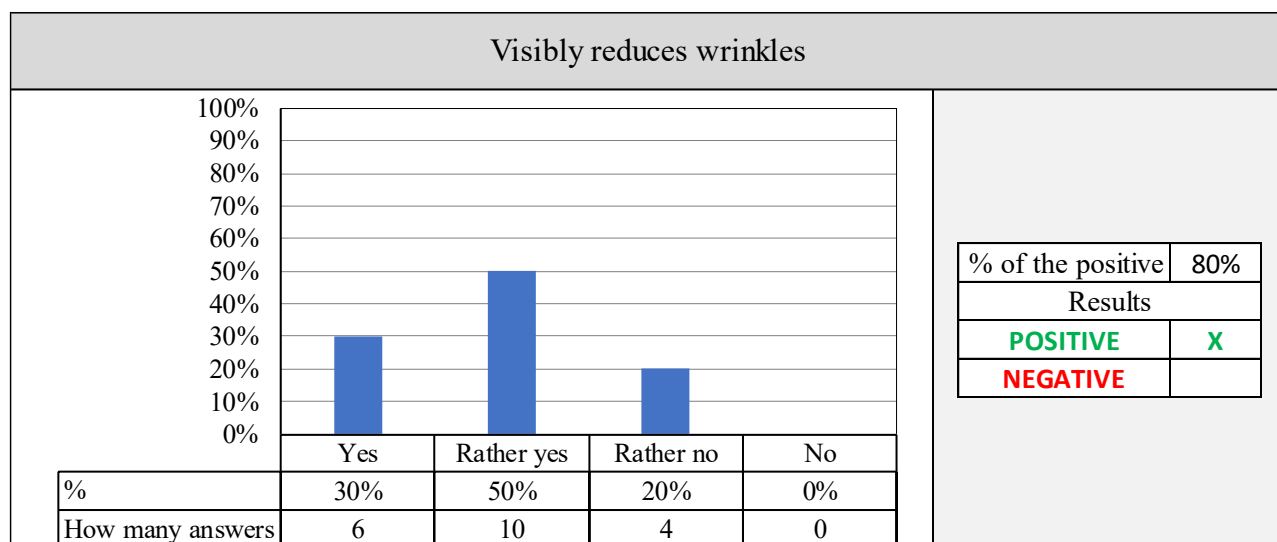
2. EVALUATION OF EFFECTS – product used regularly:









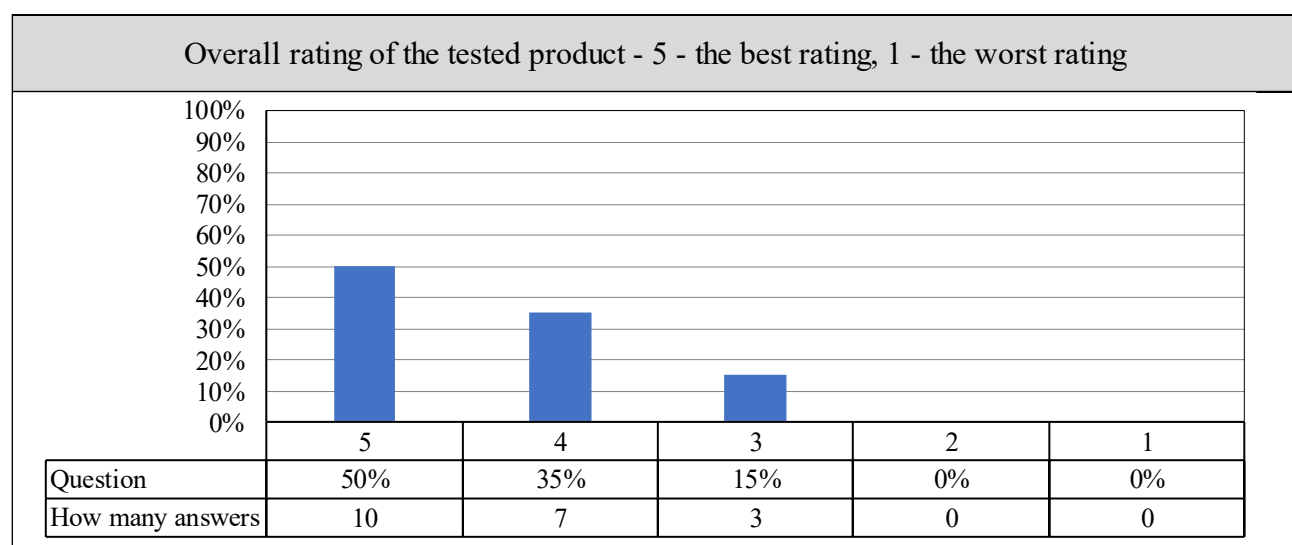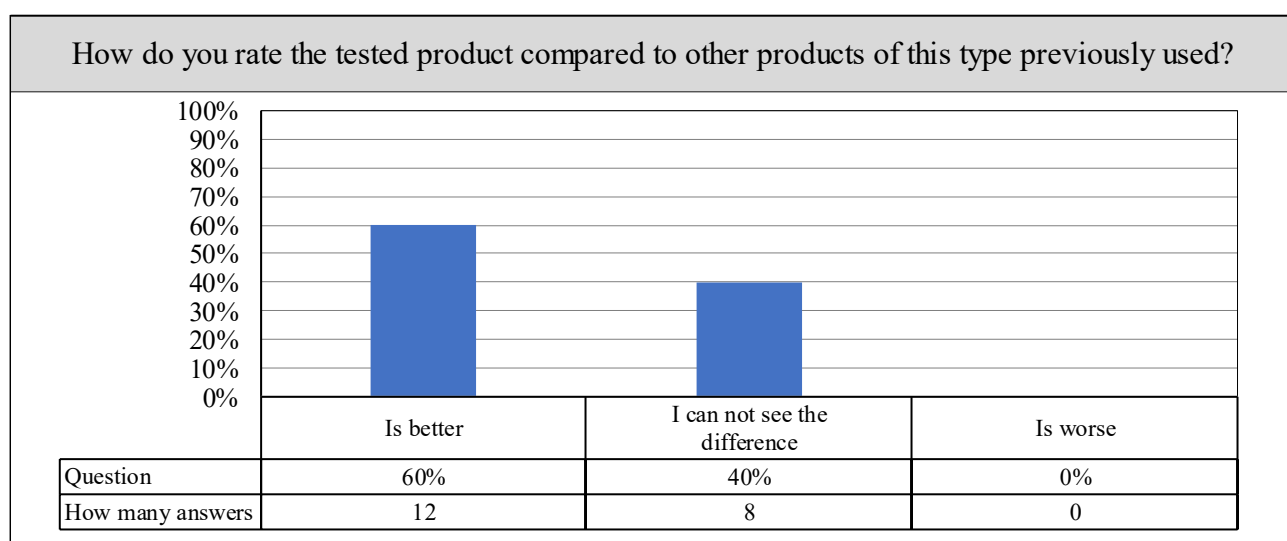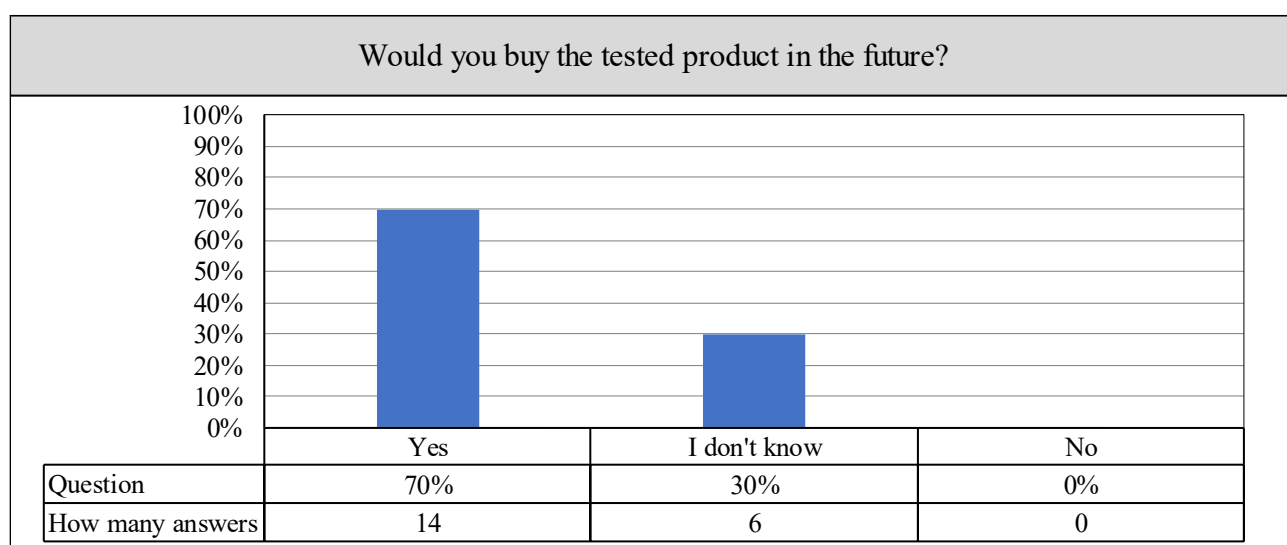3. CONSUMER EVALUATION





4. DERMATOLOGIST'S OPINION

Based on the conducted research, it was found that in case of 20 of 20 study subjects, who finished the study, the repeated application of the product (within 4 weeks) did not cause any undesirable symptoms, such as redness, swelling, rash. Moreover, none of the subjects reported any feeling of discomfort such as itching, burning, tingling.

Based on the conducted research, it was found that when applied as intended, product **Leichte Weihrauch Gesichtscreme Boswellia sacra** is safe for use in care of all types of the skin. It is suitable for sensitive skin. The above opinion does not apply to people who are allergic to any of the ingredients of the tested product.

Signed with a qualified electronic signature

Dr Dominika Perron-Plusa. Specialist in Dermatology and Venereology

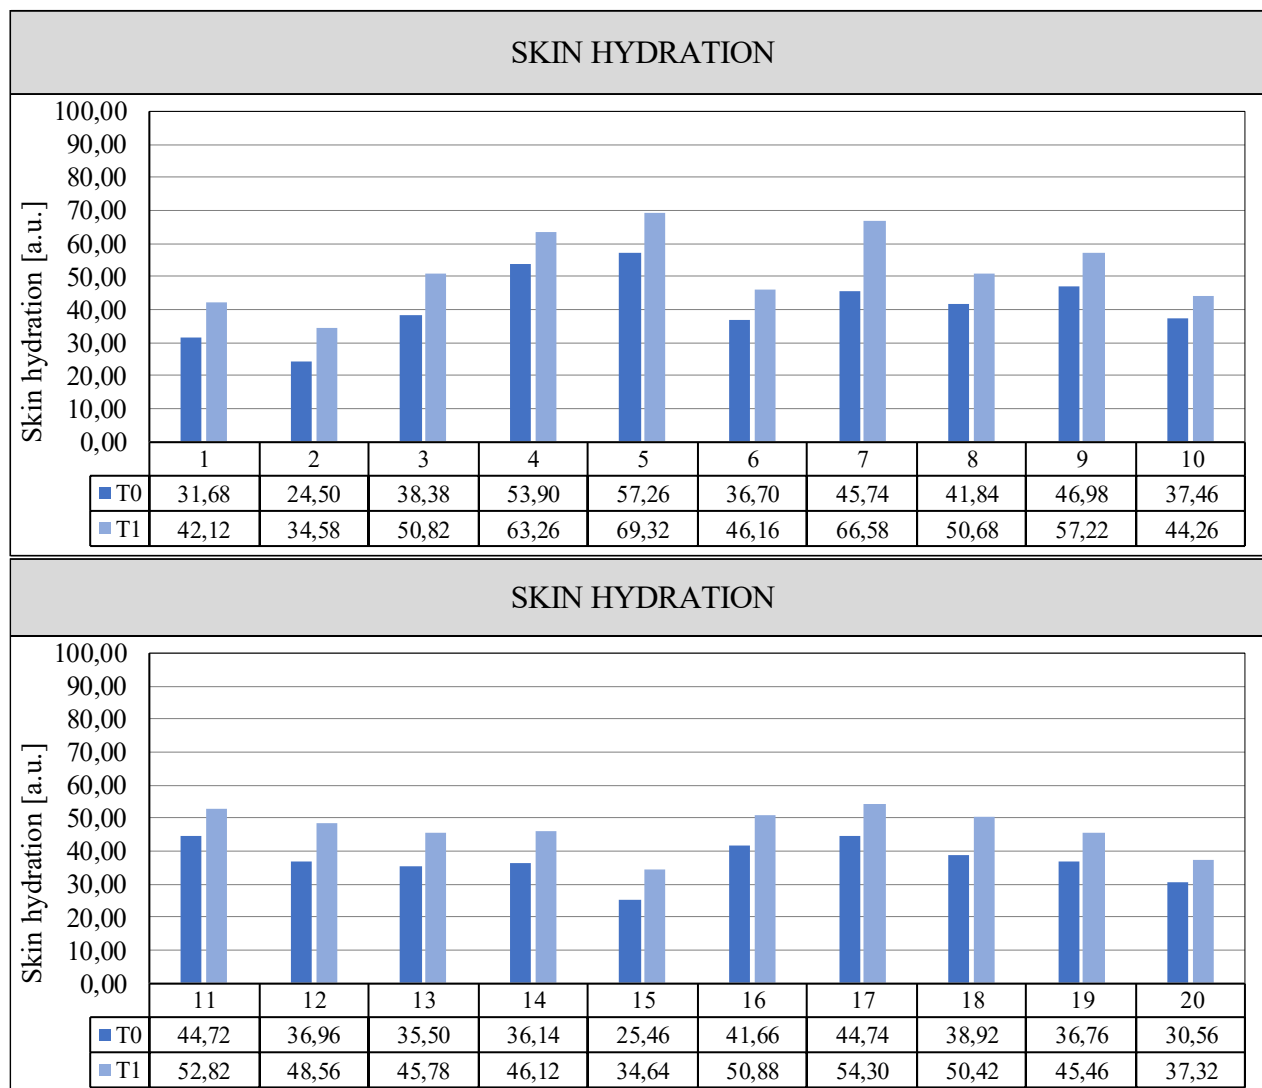
Instrumental test results - the effect of long-term (for 4 weeks) use of the product

Legend:

T₀ – initial measurement/photo taken before the first use of the product on clean skin

T₁ – final measurement/photo taken after 4 weeks of using the product on clean skin


1. Results of the moisturizing effect



	T₀	T₁
Average value of the measurements [m.u.]:	39,29	49,57
The lowest value in the group [m.u.]	24,50	34,58
The highest value in the group [m.u.]	57,26	69,32
Measurement uncertainty	3%	
The change in % calculated in the relation to the initial measurement T₀		26%
Number of people with improvement		20 of 20
It improves skin hydration by an average of 26% in the group.		

The increase of skin hydration level during T₁ is a positive result.


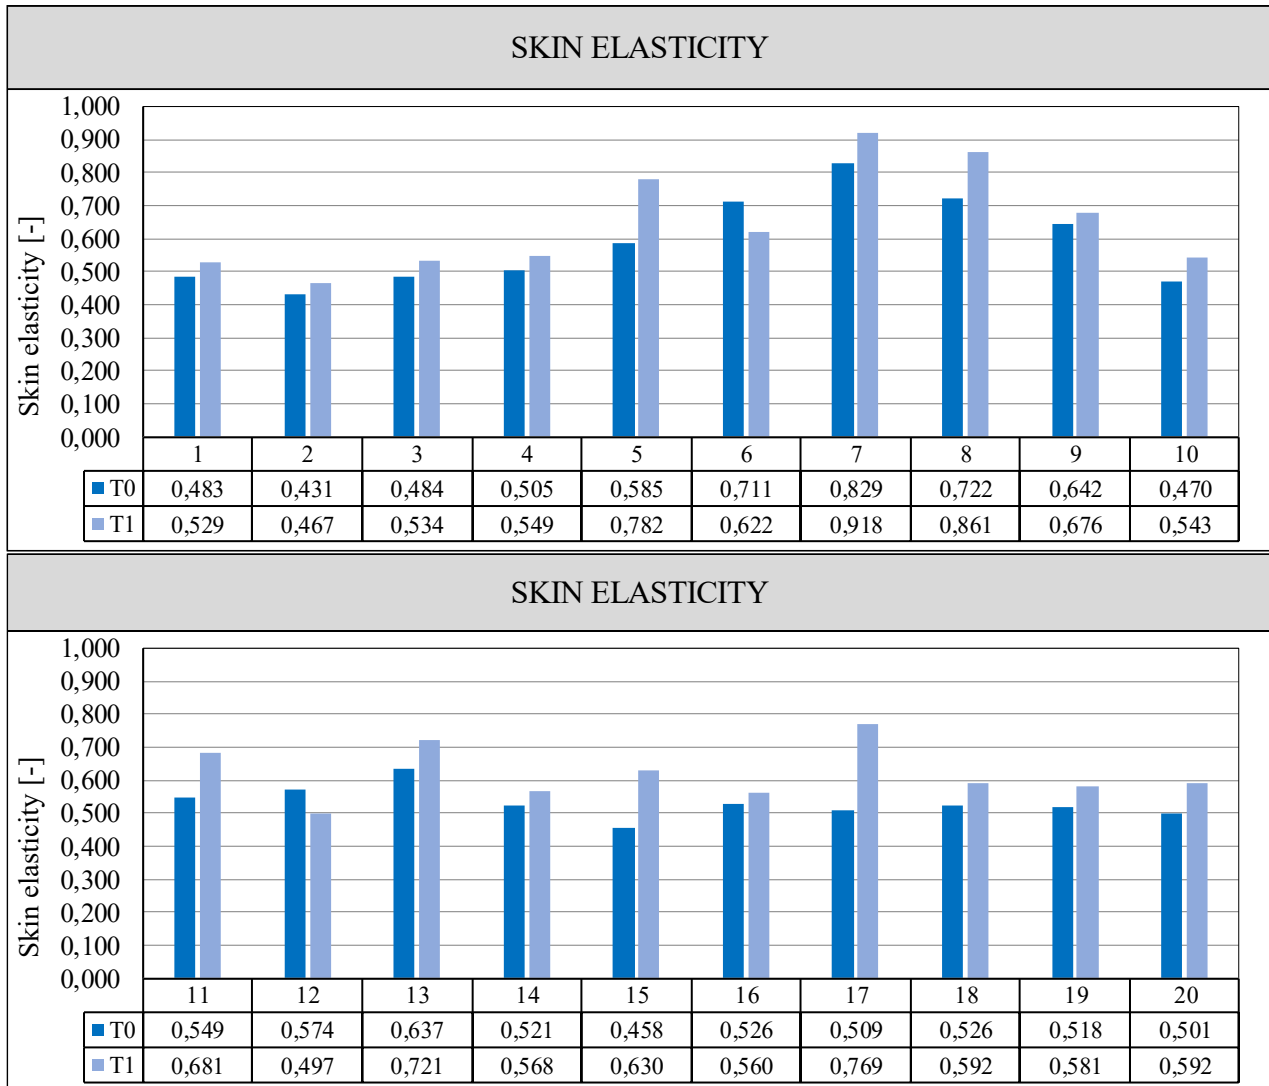
2. Results of skin elasticity effect



	T ₀	T ₁
Average value of the measurements [-]	0,559	0,633
The lowest value in the group [-]:	0,431	0,467
The highest value in the group [-]:	0,829	0,918
Measurement uncertainty	3%	
The change in % calculated in the relation to the initial measurement T ₀		13%
Number of people with improvement		18 of 20
The product improves skin elasticity by an average of 13% as a group.		

The increase in the parameter over time T₁ is a positive result - it indicates an improvement in skin elasticity.



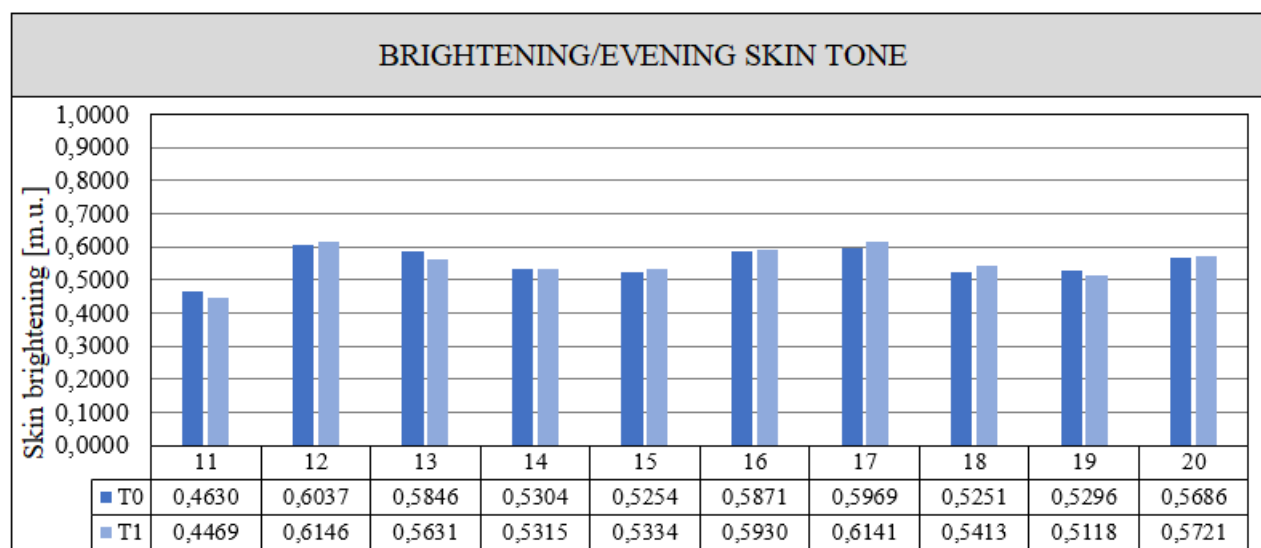
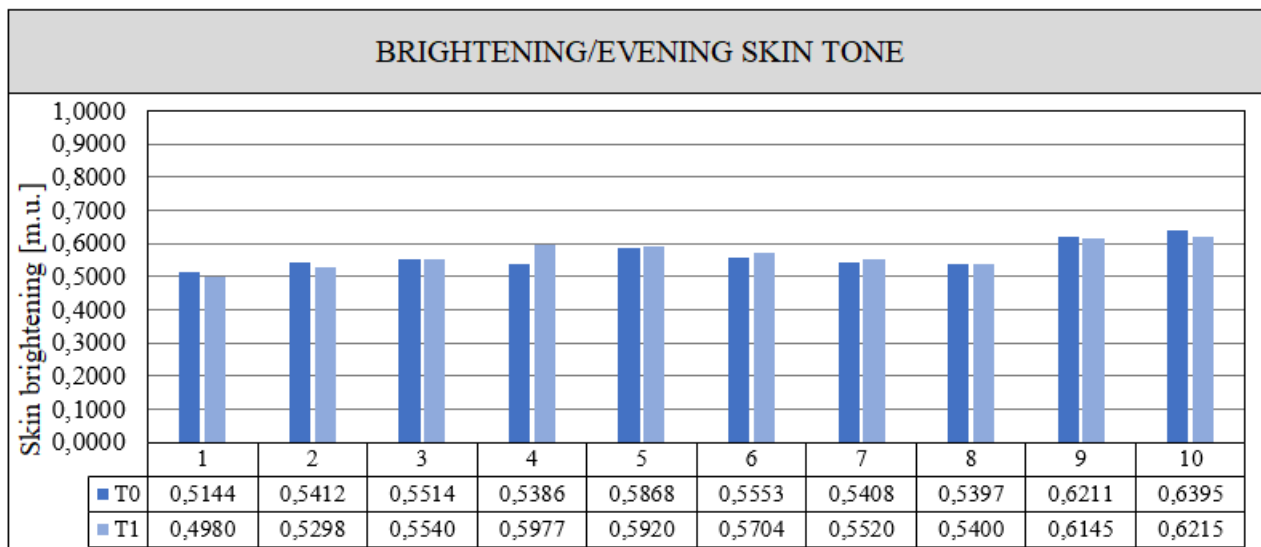
3. Results of the brightening/evening skin tone effect











	T ₀	T ₁
Average value of the measurements [m.u.]:	0,5572	0,5596
The lowest value in the group [m.u.]	0,4630	0,4469
The highest value in the group [m.u.]	0,6395	0,6215
The change in % calculated in the relation to the initial measurement T₀		0%
Number of people with improvement		7 of 20
The product does not brighten/even the skin tone.		



The decrease in the parameter over time T₁ is a positive result – it indicates a brightening of the skin tone.

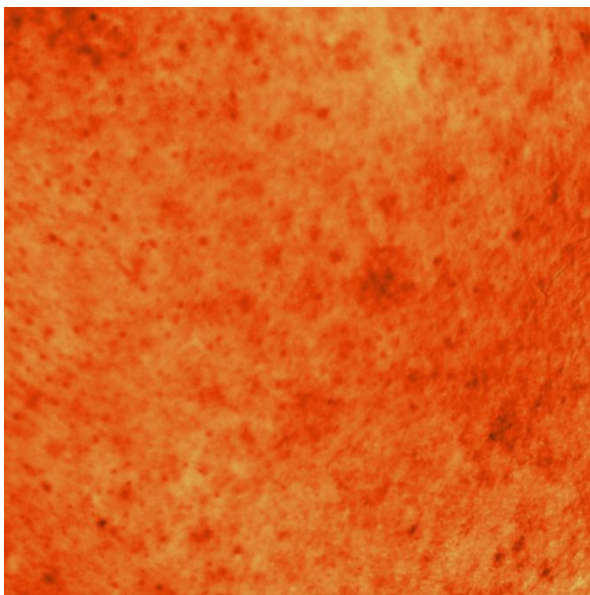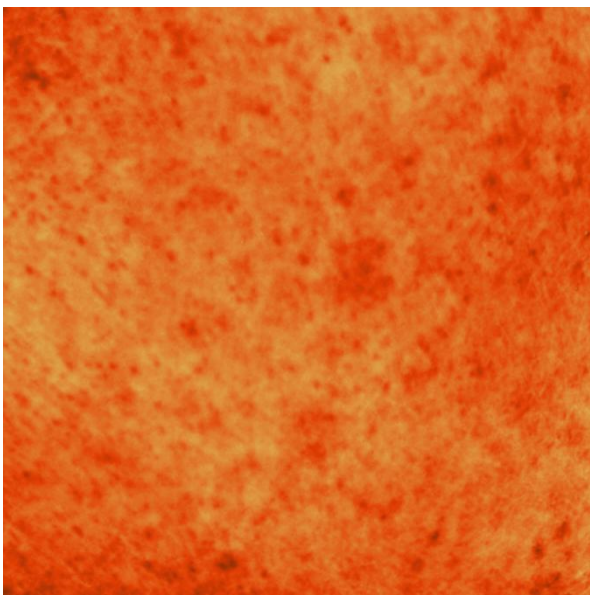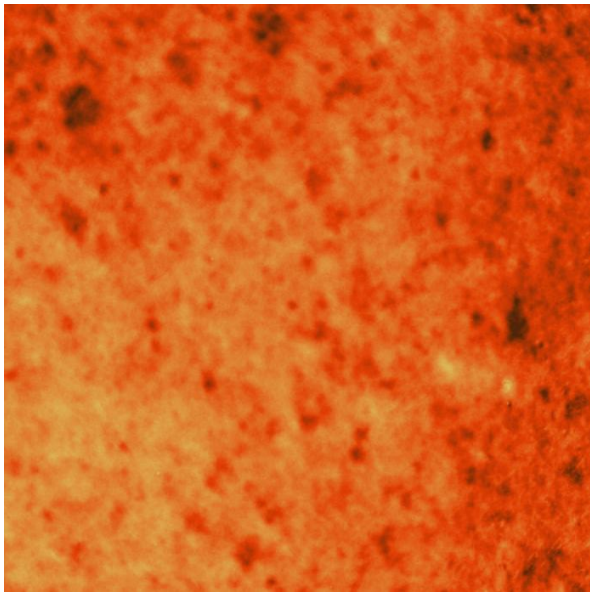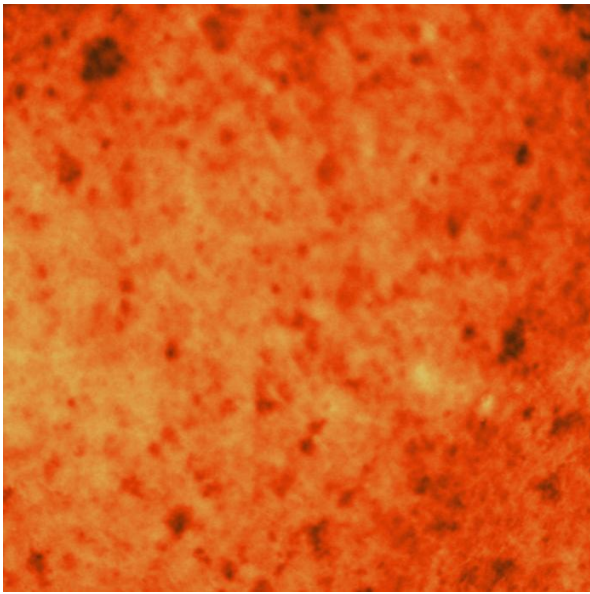Photos before and after using the product.

Subject	T ₀	T ₁
1.		
2.		

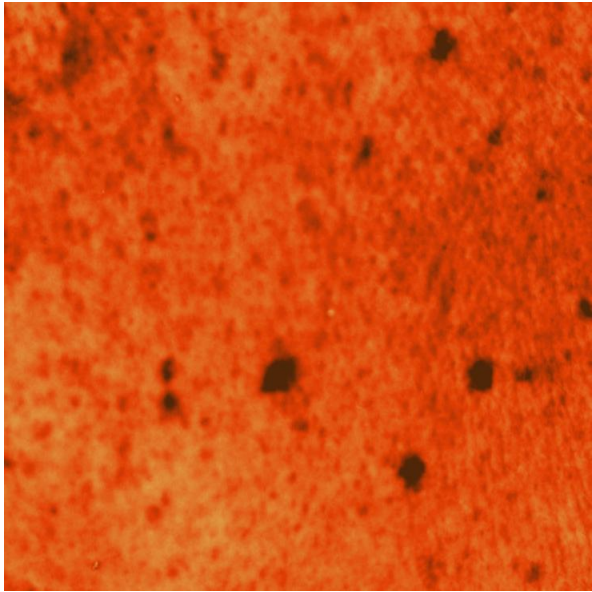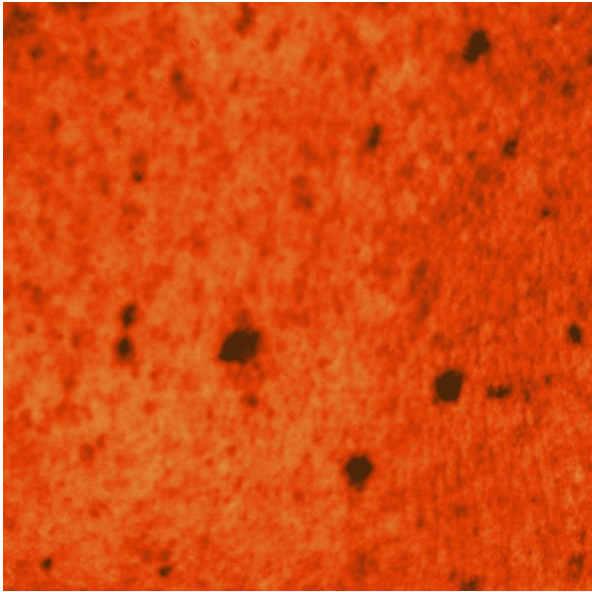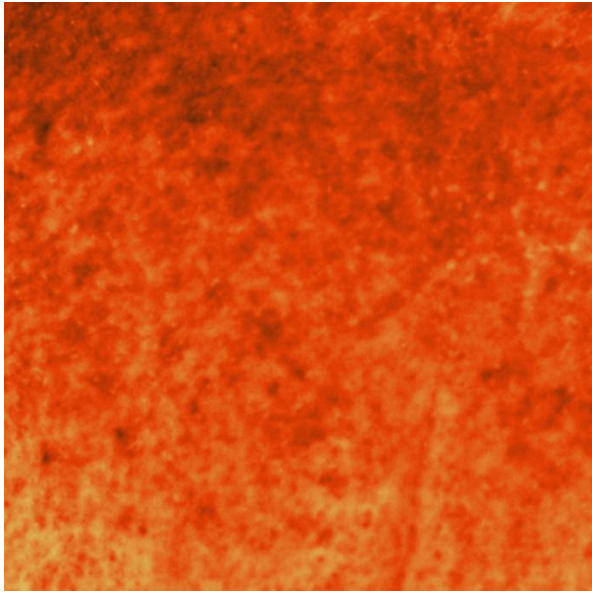
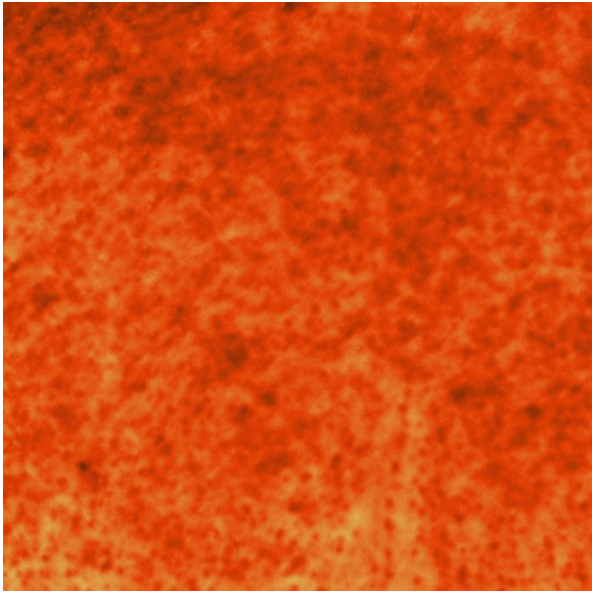
9.		
10.		

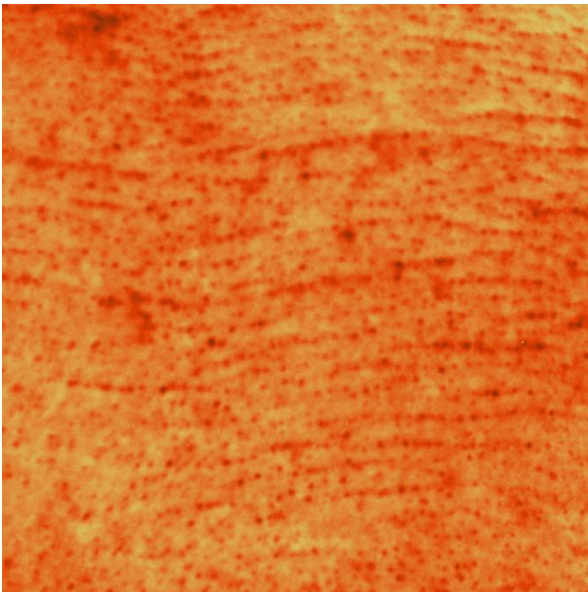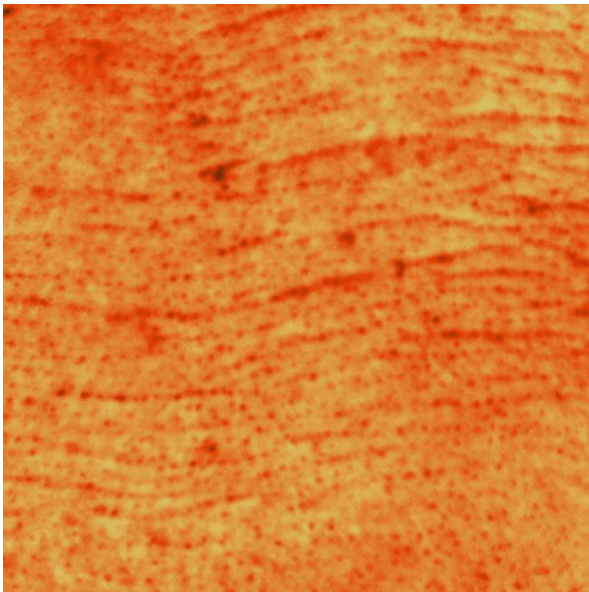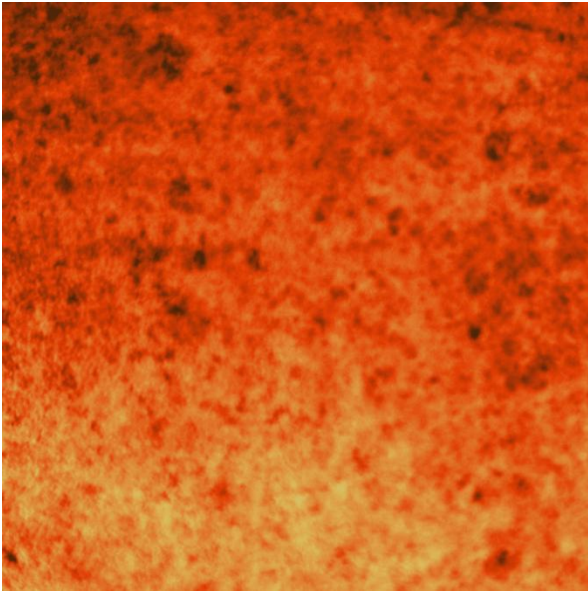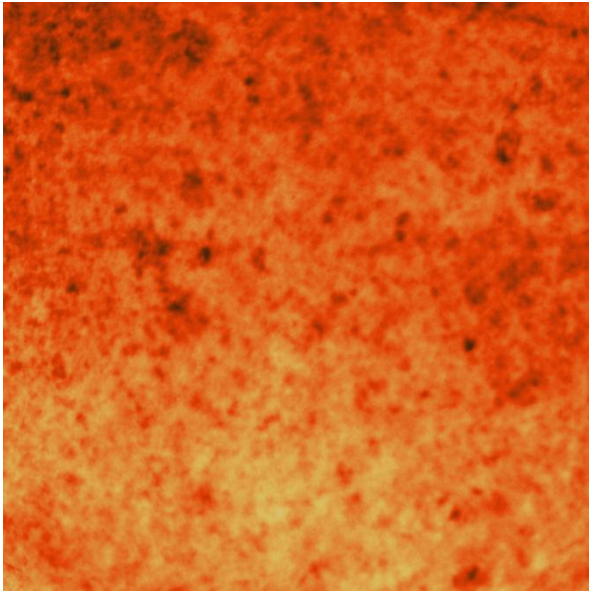11.		
13.		

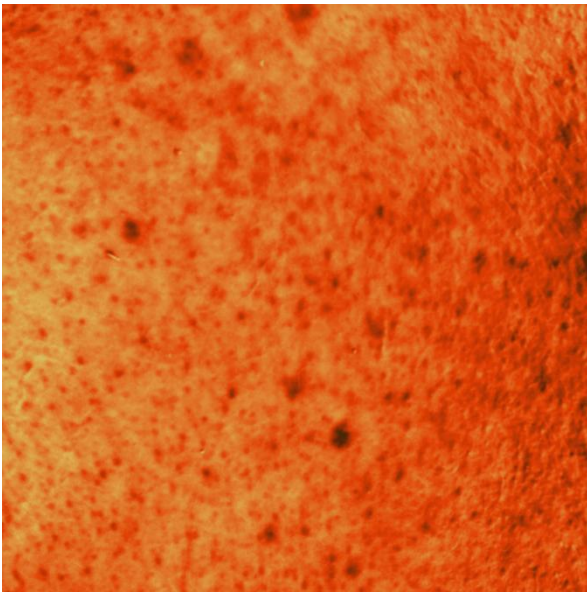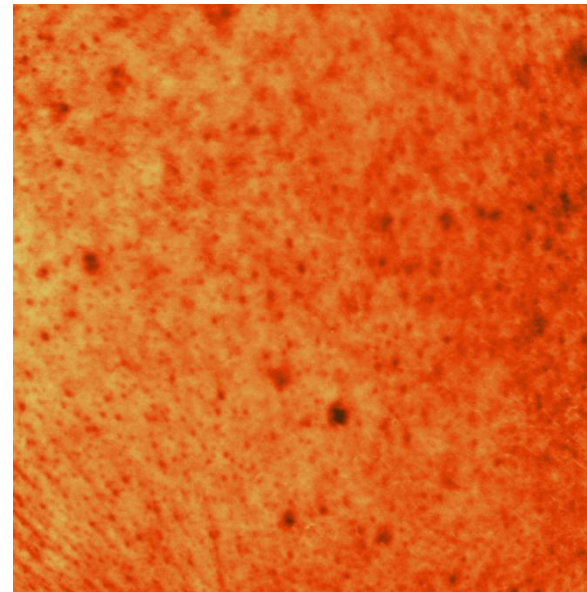19.		
-----	---	--

3. Result of wrinkle analysis

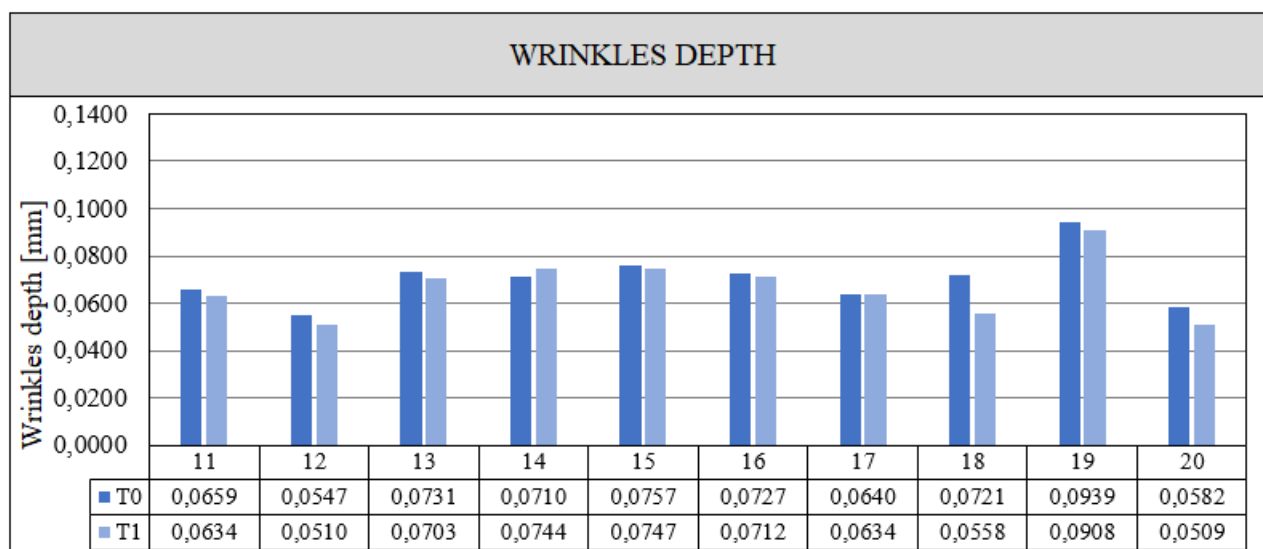
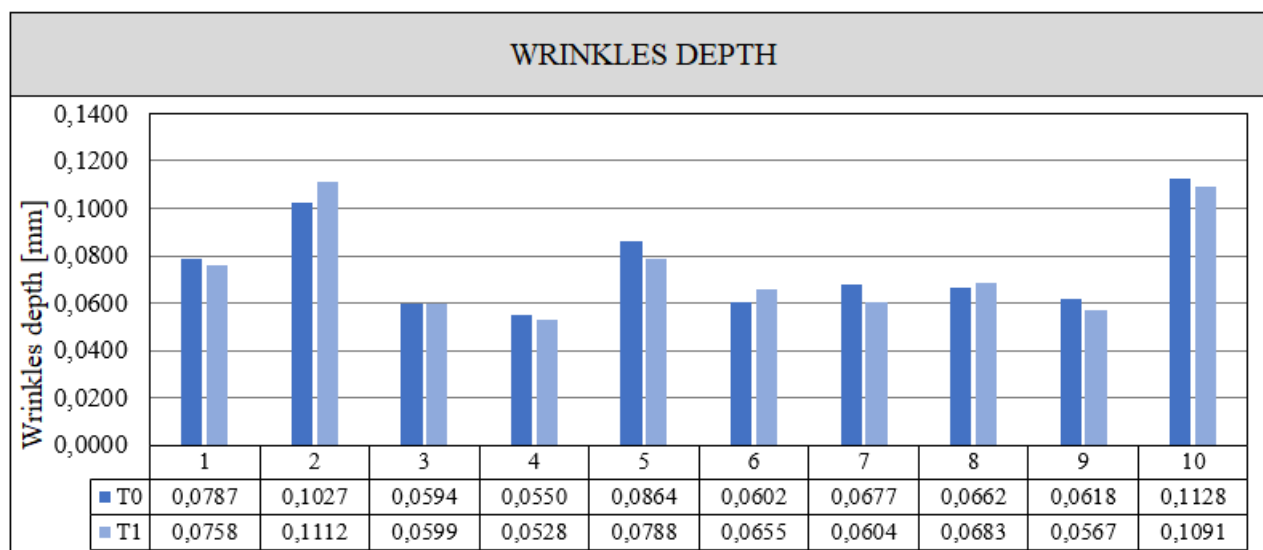
3.1. Wrinkle depth



	T ₀	T ₁
Average value of the measurements [mm]:	0,0726	0,0702
The lowest value in the group [mm]	0,0547	0,0509
The highest value in the group [mm]	0,1128	0,1112
The change in % calculated in the relation to the initial measurement T₀		3%
Number of people with improvement		15 of 20
It reduces depth of wrinkles by an average of 3% in the group.		

The decrease in the parameter over time T₁ is a positive result - it indicates a reduction in the depth of wrinkles.

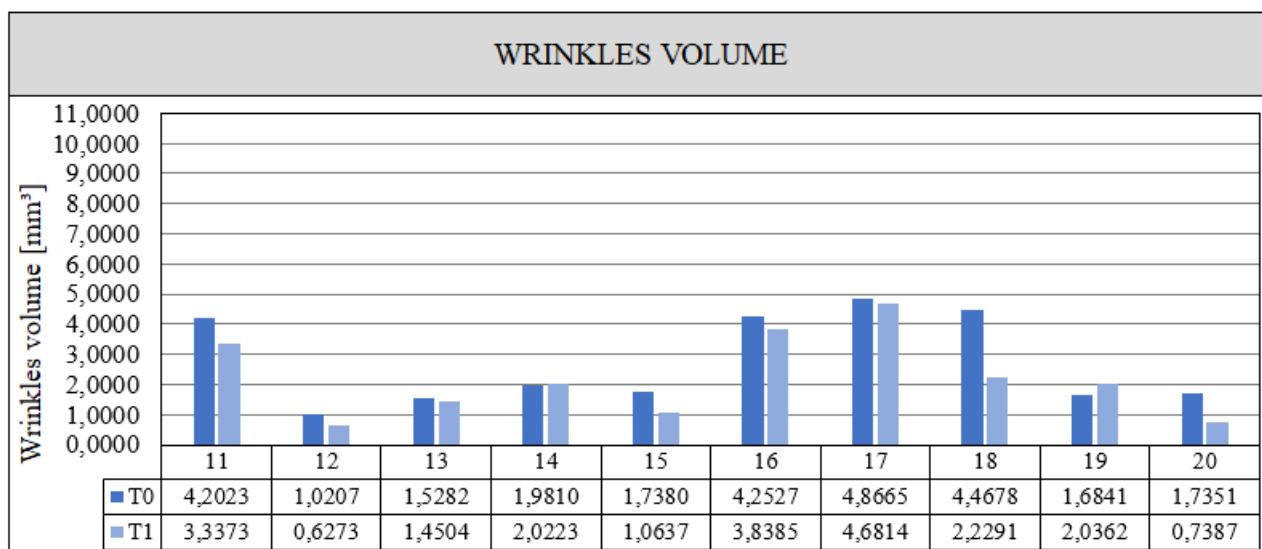
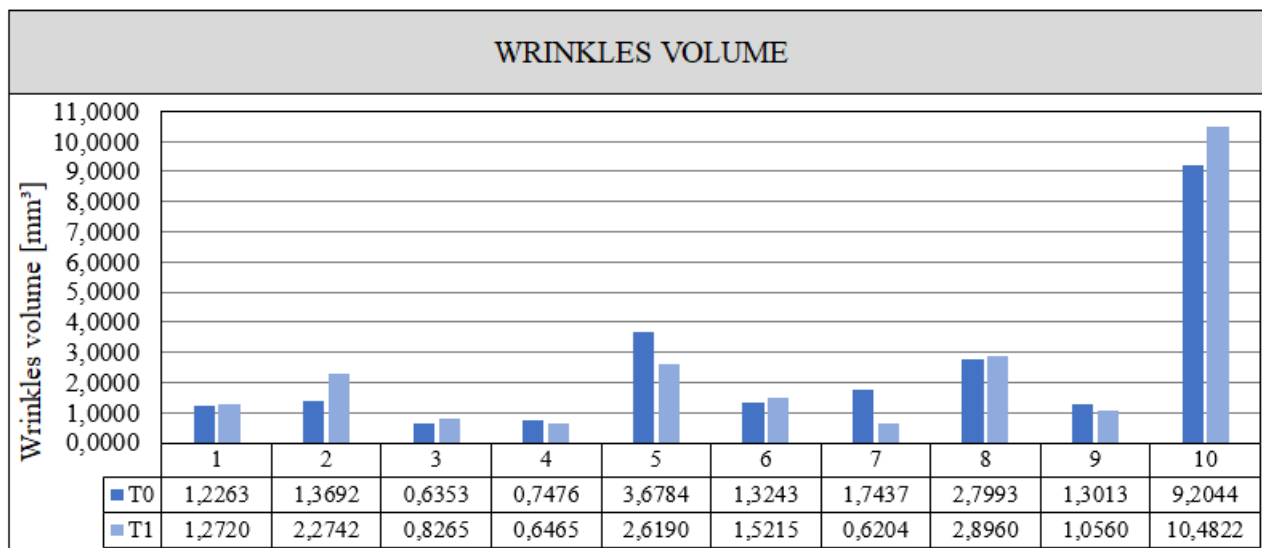
3.2. Wrinkle volume



	T ₀	T ₁
Average value of the measurements [mm³]:	2,5753	2,3120
The lowest value in the group [mm³]	0,6353	0,6204
The highest value in the group [mm³]	9,2044	10,4822
The change in % calculated in the relation to the initial measurement T ₀		10%
Number of people with improvement		12 of 20
It reduces volume of wrinkles by an average of 10% in the group.		

The decrease in the parameter over time T₁ is a positive result - it indicates a reduction in the volume of wrinkles.




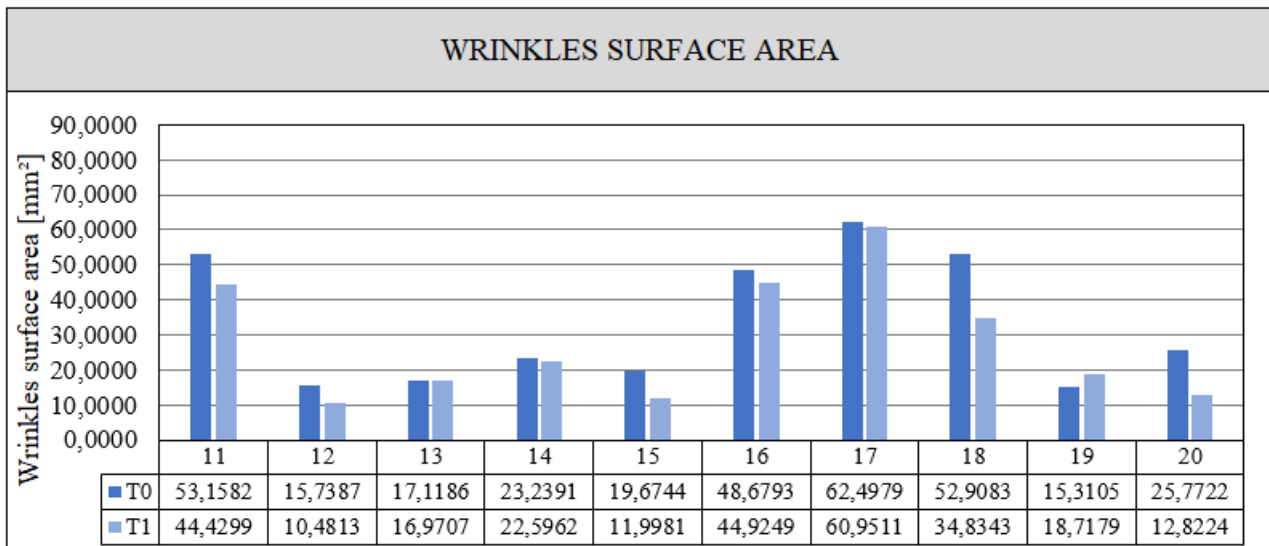
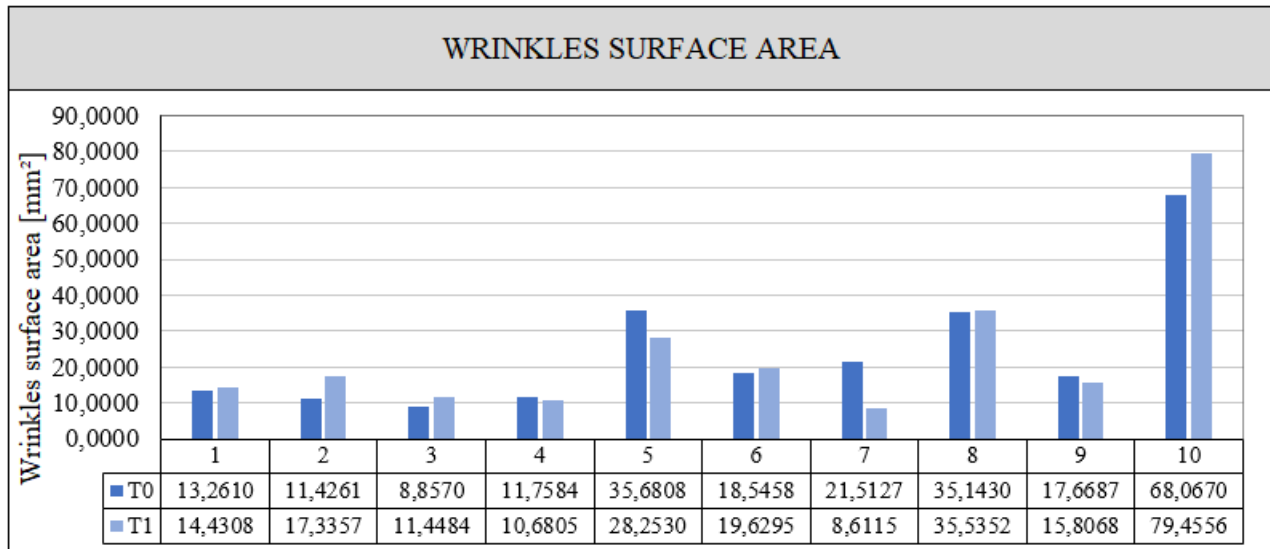
3.3. Wrinkle surface area













	T ₀	T ₁
Average value of the measurements [mm²]:	28,8009	25,9957
The lowest value in the group [mm²]	8,8570	8,6115
The highest value in the group [mm²]	68,0670	79,4556
The change in % calculated in the relation to the initial measurement T₀		10%
Number of people with improvement		13 of 20
It reduces surface area of wrinkles by an average of 10% in the group.		







The decrease in the parameter over time T₁ is a positive result - it indicates a reduction in the surface area of wrinkles.

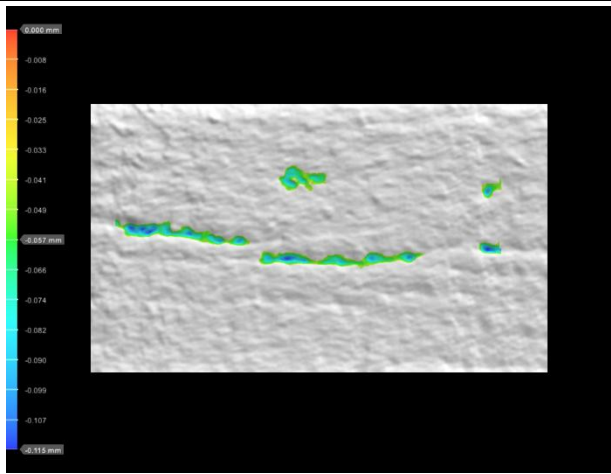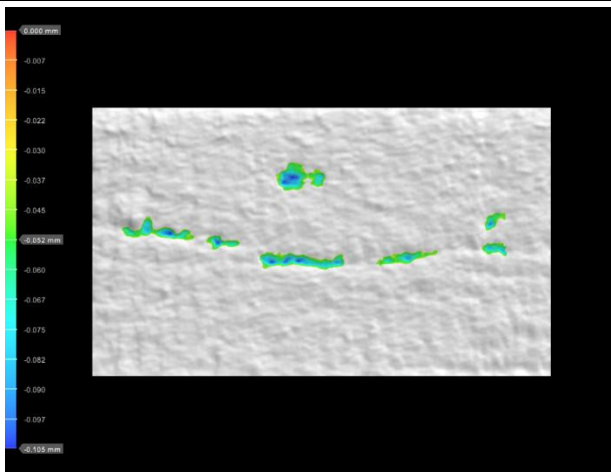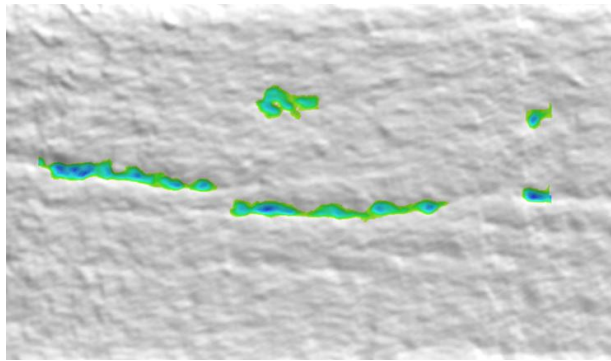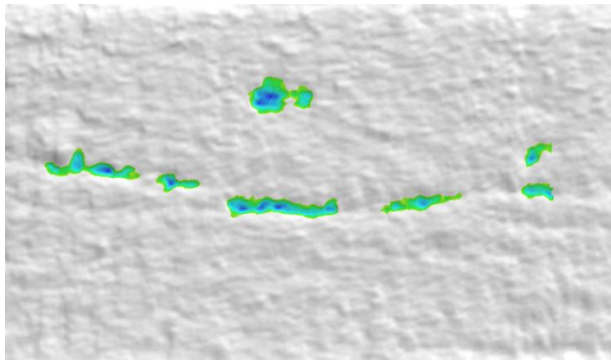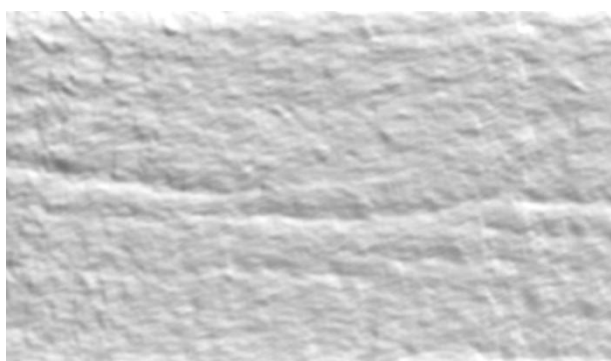Photos before and after product use.

Subject	T ₀	T ₁
4.		
		
		

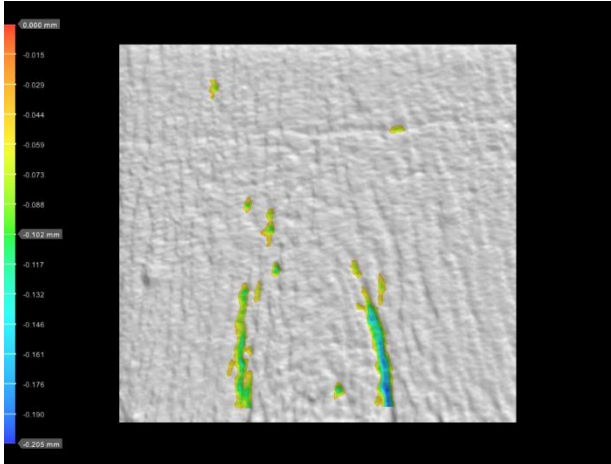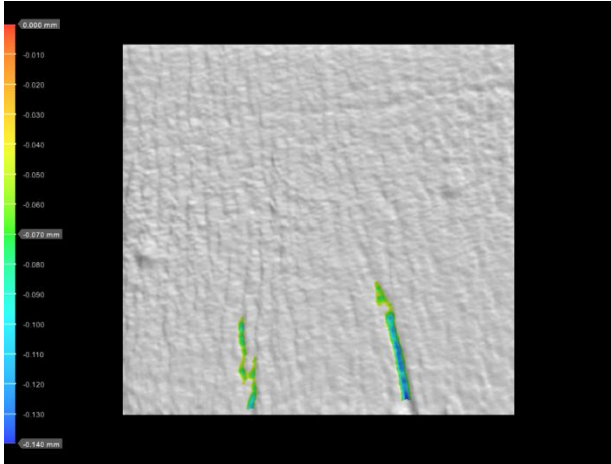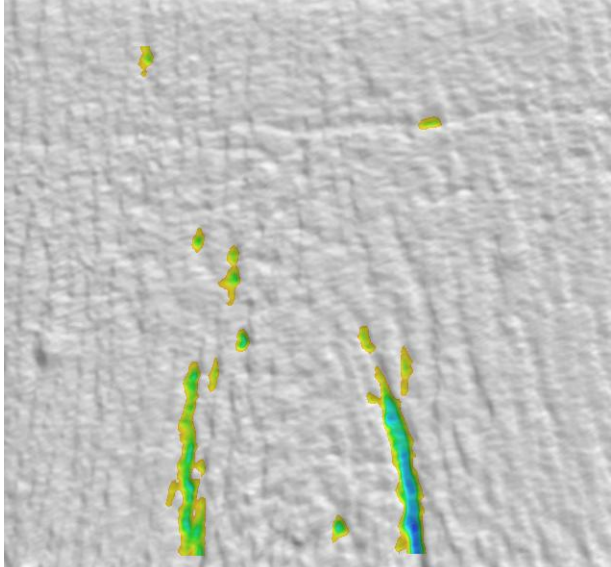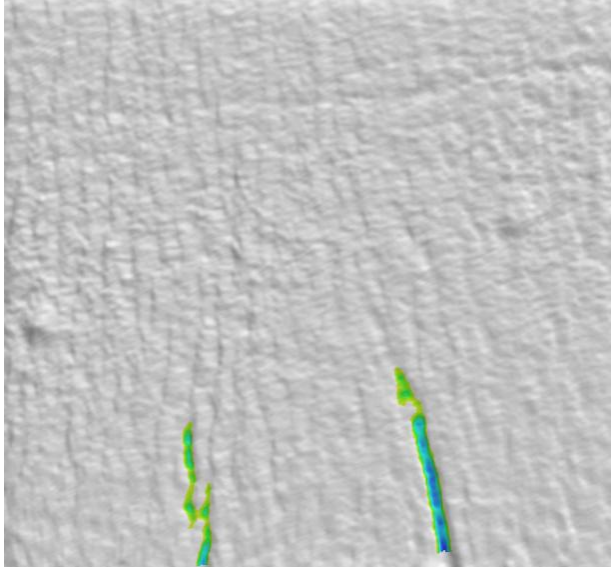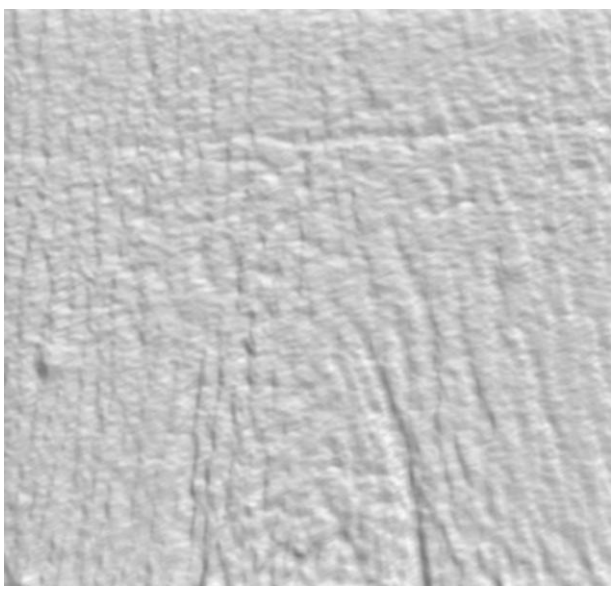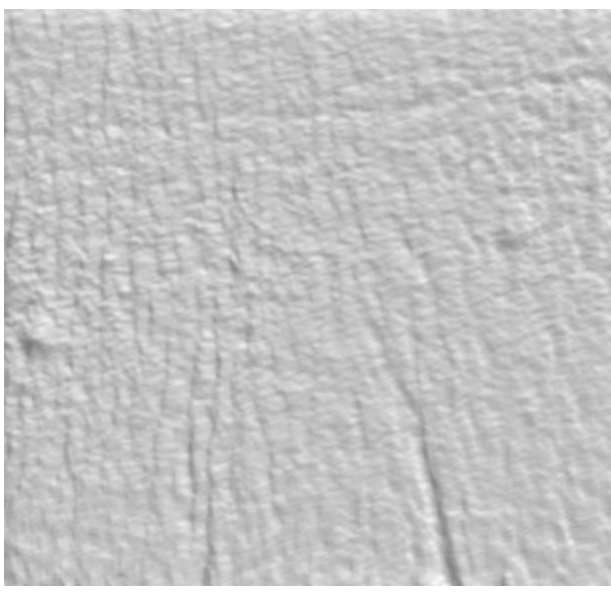Subject	T_0	T_1
7.		
		
		



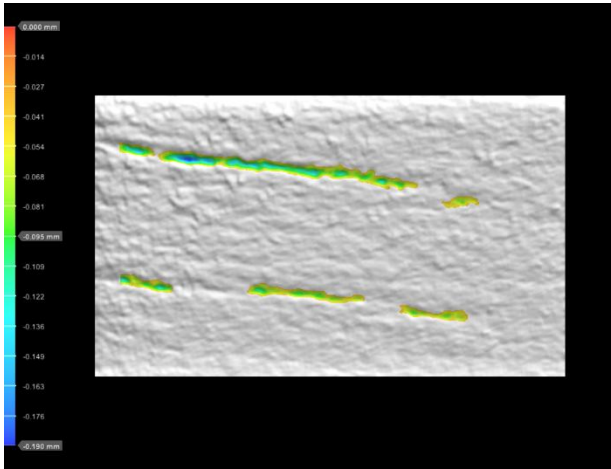
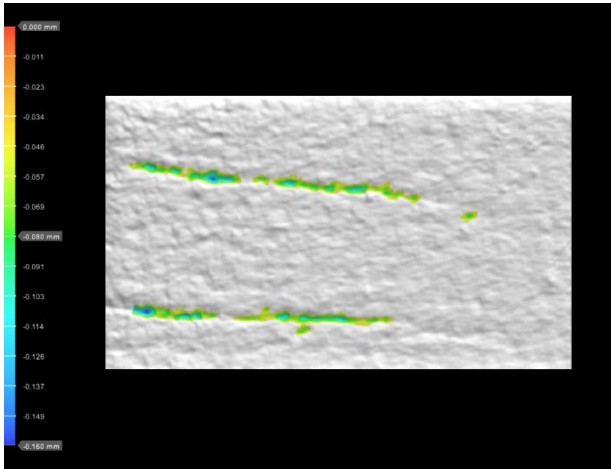
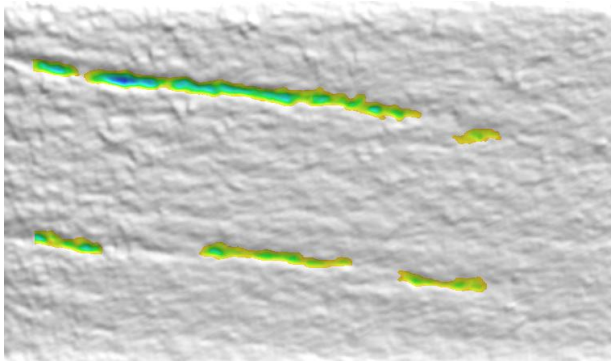
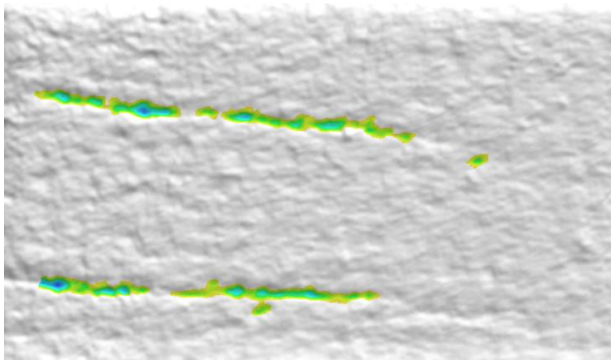
Subject	T ₀	T ₁
9.		
		
		

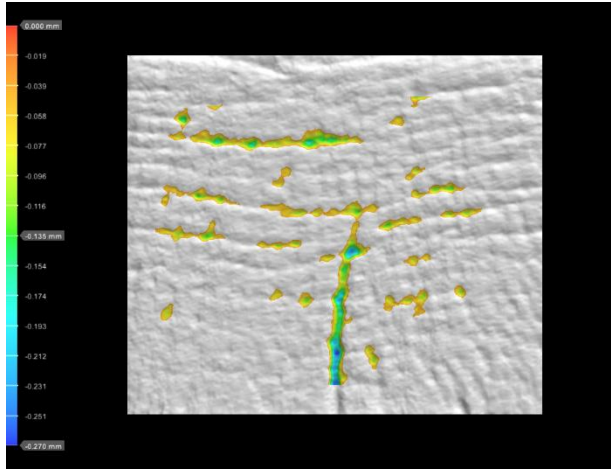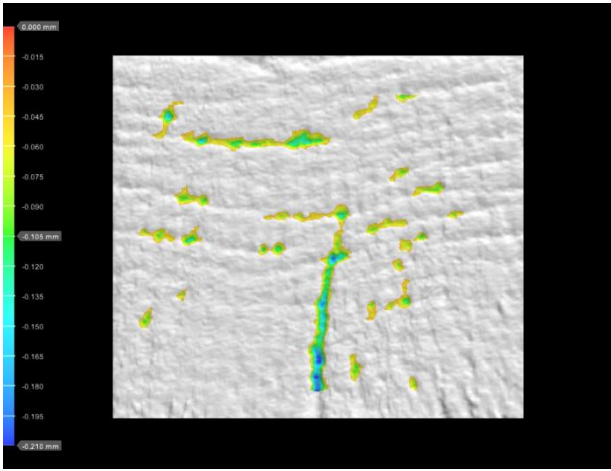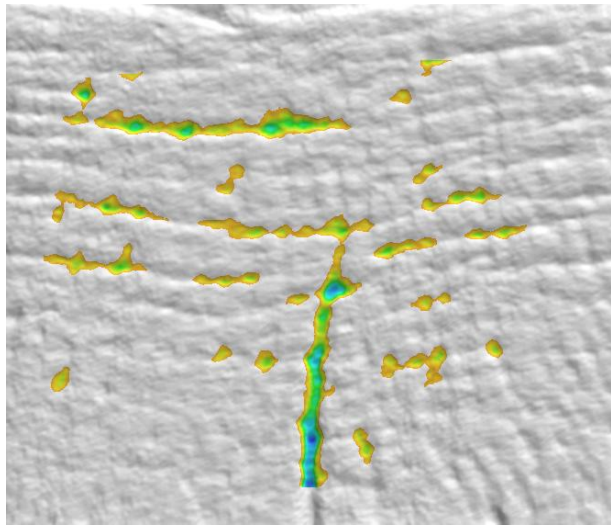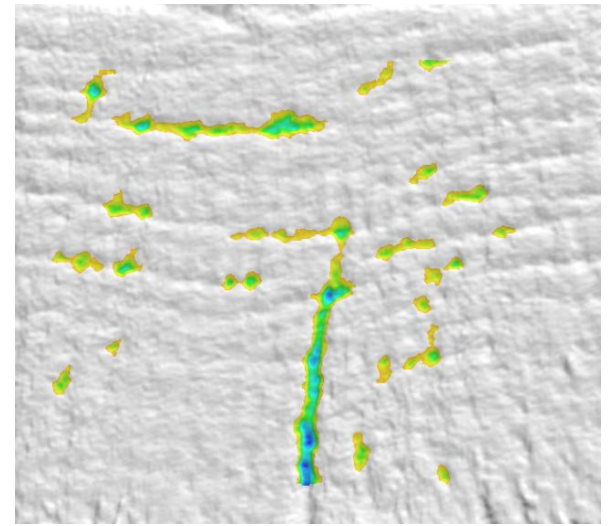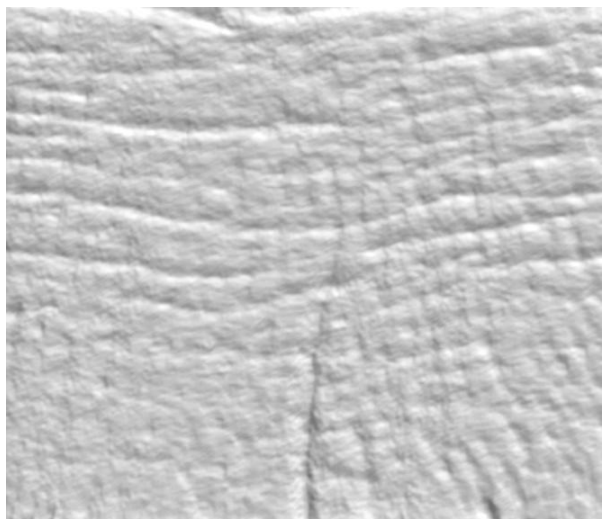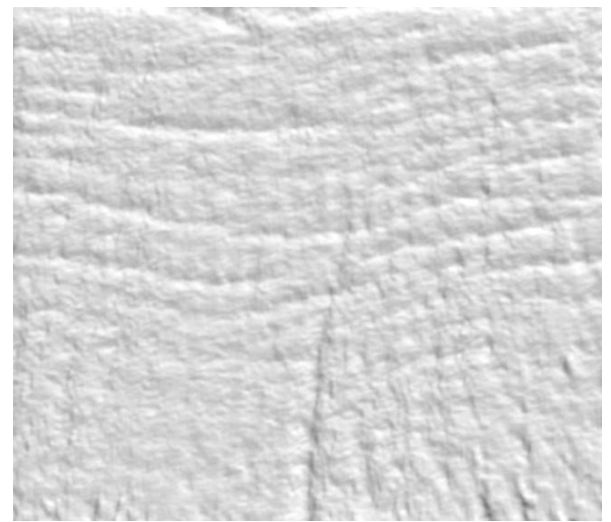Subject	T ₀	T ₁
11.		
		
		

Subject	T ₀	T ₁
12.		

Subject	T ₀	T ₁
16.		

Subject	T ₀	T ₁
18.		

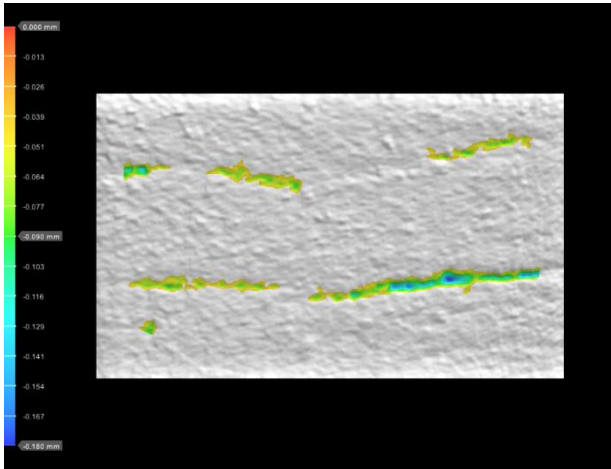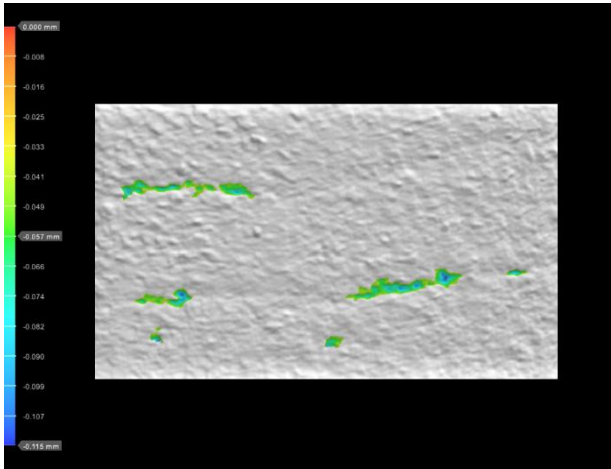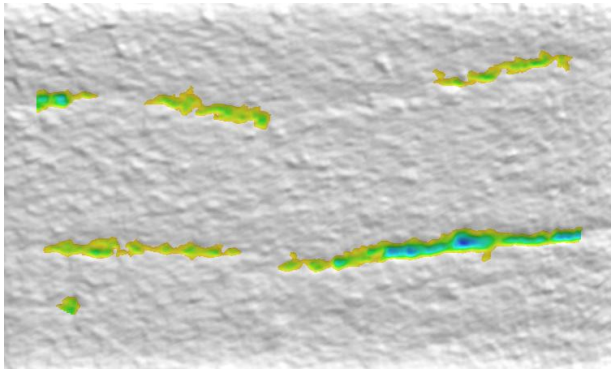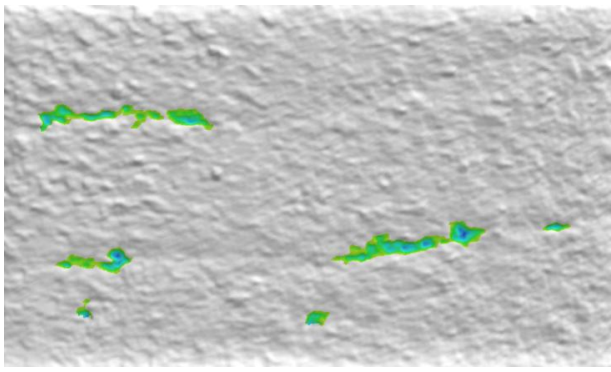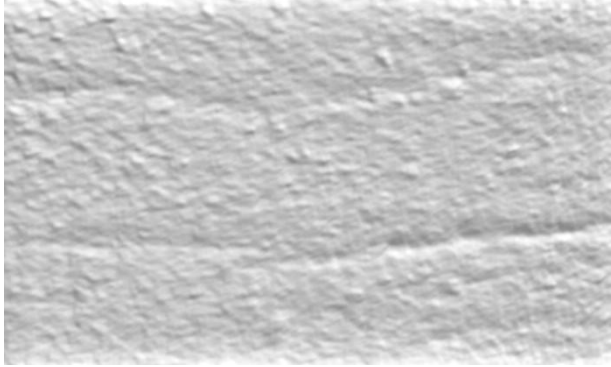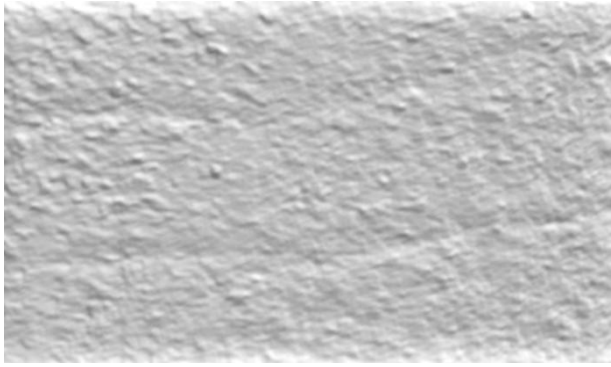Subject	T ₀	T ₁
20.		
		
		

SUMMARY

Based on the application tests carried out, it was found that the tested product called **Leichte Weihrauch Gesichtscreme Boswellia sacra**:

1. It was well tolerated by sensitive skin at the site of application because it did not cause irritation, allergic reactions or uncomfortable sensations in 20 out of 20 test subjects.
2. It fulfilled the expectations of test subjects in terms of organoleptic values, i.e.:
 - It has the proper consistency;
 - It has a pleasant fragrance with the proper intensity;
 - It applies, spreads easily;
 - It is efficient.
3. Used regularly for a period of 4 weeks (according to the method of use provided by the Manufacturer), it had a positive effect on sensitive skin. Based on the subjective feelings of the test subjects, the following manufacturer's declarations were confirmed:
 - Gives the skin moisturising sensation;
 - Visibly reduces skin redness;
 - Gives the sensation of soothing/calming the skin;
 - Noticeably firms the skin;
 - The skin is noticeably more elastic;
 - Visibly reduces wrinkles;
 - Visibly brightens discolorations.

Based on the conducted instrumental tests, the following was found about the tested product **Leichte Weihrauch Gesichtscreme Boswellia sacra** used regularly for 4 weeks:

- Moisturizes the skin by 26% on average in the group;
- Increases skin elasticity by an average of 13% in the group;
- Reduces the depth of wrinkles by an average of 3% in the group;
- Reduces the volume of wrinkles by an average of 10% in the group;
- Reduces the surface area of wrinkles by an average of 10% in the group;
- Shows good care properties.

Based on the conducted in-use and instrumental tests, it was found that the tested product **Leichte Weihrauch Gesichtscreme Boswellia sacra** can be recommended for skin care regardless of its type, especially for sensitive skin.

THE END of the Attachment

Prepared on: 29-05-2026	Prepared by: GBA POLSKA employee no.: 2766	Authorized by: GBA POLSKA employee no.: 2770
-----------------------------------	--	--